
Construction Detail

This drawing provides guidance to achieve indicative performance criteria for specific design conditions



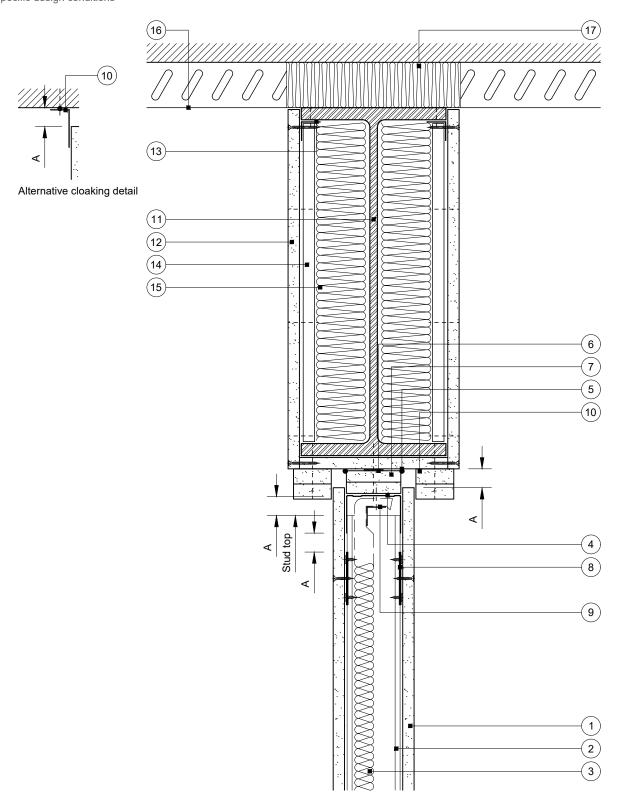

GypWall Single Frame, GypWall Single Frame Enhanced and FireCase

- One layer Gyproc plasterboard or Glasroc specialist board fixed with suitable British Gypsum screws at 300mm centres (200mm centres at external angles)
- 2 Gypframe stud type and centres as specified
- 3 Isover insulation where required
- 4 Gypframe Deep Channel or Extra Deep Channel (see table) suitably fixed through board to beam at 600mm centres (in two lines staggered by 300mm for 94mm and 148mm channels)
- 5 Gyproc Sealant for optimum sound insulation
- 6 Gyproc FireStrip
- 7 One or two channel width strip(s) of board (see table). Two strips pre-fixed to channel with suitable British Gypsum screws at 600mm centres
- 8 Gypframe GFS1 Fixing Strap fixed to each stud with two suitable British Gypsum wafer head screws to receive uppermost board fixings (no fixings into head channel)
- 9 Gypframe steel angle or timber batten suitably fixed to channel to retain insulation where required
- 10 Two 50mm width strips of Glasroc F FireCase fixed through board to beam with suitable fire resistant fixings at 600mm centres, or Gypframe Steel Angle bedded on bead of Gyproc Sealant and fixed through board to beam with suitable fire resistant fixings at 600mm centres (see table)
- 11 Indicative universal steel beam
- 12 One layer 15mm Glasroc F FireCase fixed together and to steel angles with 40mm Glasroc F FireCase Screws at 150mm centres. Board joints staggered by minimum 600mm between adjacent sides
- 13 Gypframe FEA1 Steel Angle suitably fixed to beam flange at 600mm centres
- 14 60mm wide Glasroc F FireCase backing strip at board joints
- 15 Cavity filled with Isover insulation where required
- 16 Profile sheet decking
- 17 Suitable fire stopping material by others (see important information)

DEFLECTION (VERTICAL) HEAD DESIGN			
DEFLECTION DIM. A	DROPPED SOFFIT NOTE 7	CHANNEL NOTE 4	CLOAKING ELEMENT NOTE 10
1-15mm	One 19mm ^A or 20mm ^B	DC	Two 15mm ^B or GA4
16-20mm	Two 15mm ^B	DC	Two 15mm ^B or GA4
21-25mm	Two 15mm ^B	DC	Two 20mm ^B or GA4
26-30mm	Two 20mm ^B	DC	Two 20mm ^B or GA7
31-35mm	Two 20mm ^B	EDC	Two 25mm ^B or GA7
36-40mm	Two 25mm ^B	EDC	Two 25mm ^B or GA7
41-45mm	Two 25mm ^B	EDC	Two 30mm ^B or GA7
46-50mm	Two 30mm ^B	EDC	Two 30mm ^B or GA7

^A Gyproc CoreBoard

Important information

Fire resistance BS EN 1364-1

- 30 or 60 minutes through partition subject to specification
- 60 minutes evidence based opinion room to room through beam encasement subject to partition specification

Fire protection BS EN 13381-4

60 minutes up to A/V (Hp/A) 129m⁻¹

As there is no recognised method for fire resistance testing of junctions, any performance characteristics, stated or inferred, in this detail are estimated based on each system tested in isolation and other relevant test data. The drawing should be approved by the project design and management authority before use to ensure that it meets with their specific project requirements

Performance characteristics of the British Gypsum system must be maintained. It is important that a suitable fire stopping product with appropriate fire resistance substantiation is sought from a third party manufacturer

Deflection head to underside of encased beam

Downward (vertical) Movement

Rev. B 21.03.24 Added GA7 (MBH)

Title: Construction detail

Scale at A3: 1:5

Drawn: MRC

Date: December 2021

Approved: MKF JMC

Dwg No.: CN-121-017

Revision: B

Technical Support Team | british-gypsum.com

This drawing is provided to customers free of charge and the details shown are subject to the accuracy of the information provided to British Gypsum at the time the drawing was originally requested. The drawing should therefore be approved by the project design and managem authority before use to ensure that it meets with their specific project requirements. It should also be read in conjunction with British Gypsum's current literature available at www.british-gypsum.com. Taping and finishing in accordance with British Gypsum's current literature available at www.british-gypsum.com. Taping and finishing in accordance with British Gypsum's current literature available at www.british-gypsum.com. To specifying Authority for specification details. This drawing is valid at the time of iss please check with British Gypsum for the latest version. No duly of care is owned to the recipient or any third party and British Gypsum and British Gypsum for details shown save where death or personal injury is caused due to British Gypsum for grant gra

^B Glasroc F FireCase