


Construction Detail


This drawing provides guidance to achieve indicative performance criteria for specific design conditions

GypWall Single Frame and GypWall Single Frame Enhanced

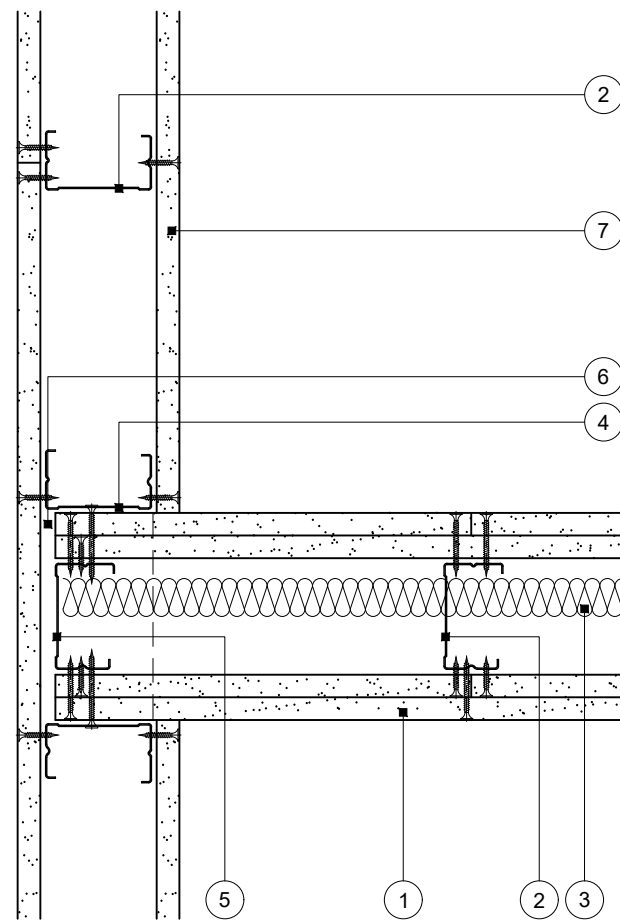


Plan


T-junction other partition
High meeting low acoustic performance

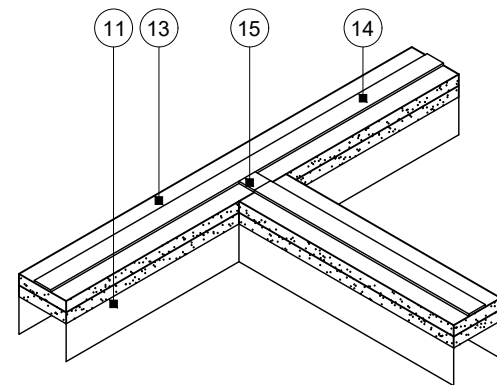


Dropped soffit arrangement (1:10)

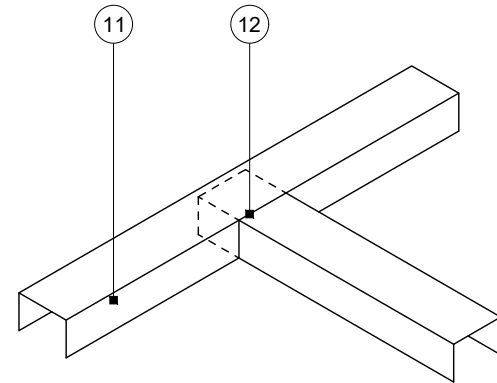

Head channel arrangement (1:10)

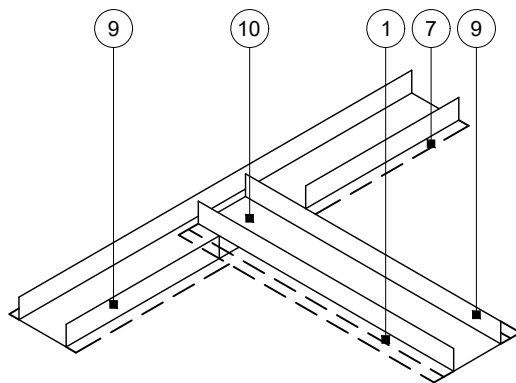

Floor channel arrangement (1:10)

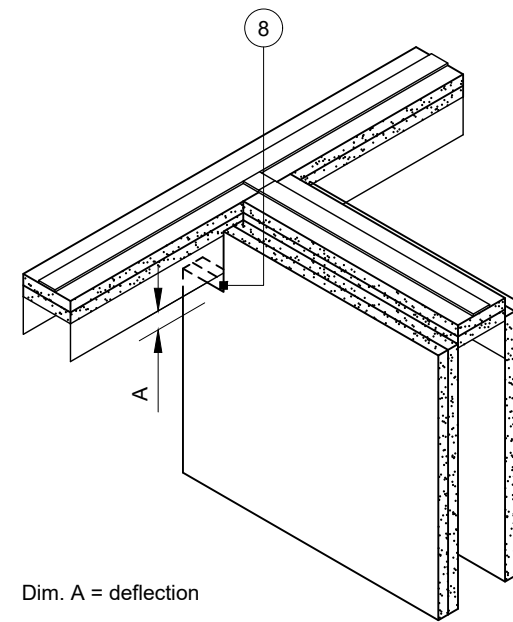

Dim. A = deflection

Board arrangement (1:10)

Studs and adjacent board lining not shown for clarity

Deflection head cloaking element (Gypframe angles or Glasroc strips) not shown for clarity. Refer to deflection head detail for specification

- 1 Two layers Gyproc plasterboard or Glasroc specialist board fixed with suitable British Gypsum screws at 300mm centres (200mm centres at external angles)
- 2 Gypframe 'C' studs at specified centres
- 3 Isover insulation where required
- 4 Gypframe 'C' stud fixed through board to stud(s) with suitable British Gypsum screws at 600mm centres (in two lines staggered by 300mm for 92mm and 146mm studs)
- 5 Additional Gypframe 'C' stud at junction (two for 92mm and 146mm studs in adjacent partition)
- 6 Nominal 10mm gap between boards
- 7 One layer Gyproc plasterboard or Glasroc specialist board fixed with suitable British Gypsum screws at 300mm centres (200mm centres at external angles)
- 8 Board cut around head channel with sufficient clearance for deflection
- 9 Gypframe Channel suitably fixed to floor at 600mm centres (in two lines staggered by 300mm for 94mm and 148mm channels). Deep Channel for heights between 4200mm and 8000mm or Extra Deep Channel for heights over 8000mm
- 10 Channel cut and bent to allow channel and board of abutting partition to run through
- 11 Gypframe channel to suit deflection suitably fixed through board to soffit at 600mm centres (in two lines staggered by 300mm for 94mm and 148mm channels)
- 12 Channel cut and bent to allow channel of abutting partition to run through
- 13 One or two channel width strip(s) of board to suit deflection. Two strips pre-fixed to channel with suitable British Gypsum screws at 600mm centres
- 14 Gyproc FireStrip
- 15 Additional short length of Gyproc FireStrip

Important information

- Fire resistance BS EN 1364-1
- Estimated 30 or 60 minutes through partition junction subject to specification

As there is no recognised method for fire resistance testing of junctions, any performance characteristics, stated or inferred, in this detail are estimated based on each system tested in isolation and other relevant test data. The drawing should be approved by the project design and management authority before use to ensure that it meets with their specific project requirements

Title: Construction detail

Scale at A3: 1:5

Drawn: MRC

Date: January 2022

Approved: MKF JMC

Dwg No.: CN-121-048

Revision:

Technical Support Team | british-gypsum.com

This drawing is provided to customers free of charge and the details shown are subject to the accuracy of the information provided to British Gypsum at the time the drawing was originally requested. The drawing should therefore be approved by the project design and management authority before use to ensure that it meets with their specific project requirements. It should also be read in conjunction with British Gypsum's current literature available at www.british-gypsum.com. Taping and finishing in accordance with British Gypsum's current recommendations is assumed (with the exception of FireCase system). Please note the drawing may show British Gypsum products fixed by or to products that are non-British Gypsum products/fixings please refer to Specifying Authority for specification details. This drawing is valid at the time of issue, please check with British Gypsum for the latest version. No duty of care is owed to the recipient or any third party and British Gypsum excludes all liability in respect of the details shown save where death or personal injury is caused due to British Gypsum's negligence or for fraud.