


Technical Specification

This document provides guidance on how to achieve performance and warranty requirements by exclusively using British Gypsum products or system specifications.

GypWall Resilient

Q606040S (EN)

Inner layer of Gyproc FireLine 15mm with an outer layer of Gyproc DuraLine 15mm each side of Gypframe 70 S 50 'C' Studs at 600mm centres with Gypframe RB1 Resilient Bar at 600mm centres to one side. 50mm Isover Acoustic Partition Roll (APR 1200) in the cavity with 2mm Thistle MultiFinish on each side. For heights up to 4000mm.

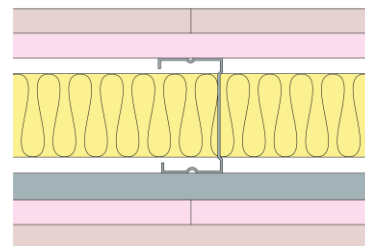

Head design

Head channel	Gypframe 72 FEC 50 Folded Edge Standard Floor & Ceiling Channel
Gypframe channel suitably fixed to soffit at 600mm centres.	
Deflection allowance	Vertical deflection only. To be determined by a Structural Engineer.
Dropped soffit	For principles of deflection head construction refer to detail ST-124-Z4L2-11.

Framework

Stud	Gypframe 70 S 50 'C' Stud
Stud centres - Max (mm)	600
Abutments and openings	Gypframe 70 S 50 'C' Stud
Gypframe 'C' stud suitably fixed to structure at 600mm centres.	
Horizontal bar type, Side 1	Gypframe RB1 Resilient Bar
Horizontal bar centres - Max (mm)	600
Horizontal bar fixing	British Gypsum Wafer Head Drywall Screws 13mm
Horizontal resilient bars and short lengths of resilient bar (between horizontal bars at perimeters) fixed using wafer head screws.	
Base channel	Gypframe 72 FEC 50 Folded Edge Standard Floor & Ceiling Channel
Gypframe channel suitably fixed to floor at 600mm centres.	

Insulation

Insulation, Layer 1	50mm Isover Acoustic Partition Roll (APR 1200)
---------------------	---

Board and fixings

Board side 1, Layer 1	Gyproc FireLine 15mm	Screws side 1, Layer 1	British Gypsum Drywall Screws 25mm
Board side 1, Layer 2	Gyproc DuraLine 15mm	Screws side 1, Layer 2	British Gypsum Drywall Screws 40mm
Board side 2, Layer 1	Gyproc FireLine 15mm	Screws side 2, Layer 1	British Gypsum Drywall Screws 25mm
Board side 2, Layer 2	Gyproc DuraLine 15mm	Screws side 2, Layer 2	British Gypsum Drywall Screws 40mm

Board layer 1 (inner), fix securely to Gypframe metal supports around the perimeter of the board at maximum 300mm centres; Board layer 2 (outer), fix securely to all Gypframe metal supports around the perimeter of the board and intermediate stud positions (for RB1 supports, fix around the perimeter and within the field of the board) at maximum 300mm centres. External corners reduce fixings to 200mm. All joints staggered between layers. Fix working from the centre of each board. Position screws not less than 13mm from cut edges and 10mm from bound edges of boards. Set screw heads flush with plasterboard surface; do not break paper or gypsum core.

Fixing strap	Gypframe GFS1 Fixing Strap
Used to support horizontal board joints in face layer of multiple layer board linings (to side without Resilient Bars) and enable board screw fixing at 300mm centres.	
Sealant	Gyproc Sealant
Locate sealant at junctions with adjoining structure and other air paths. Apply as a continuous bead to clean, dry, dust-free surfaces, leaving no gaps. After application of sealant, bulk fill gaps between floor and underside of plasterboard using Gyproc joint compound.	

Finish coat

Finish coat, Side 1	Thistle MultiFinish	Thickness, Side 1 (mm)	2
Finish coat, Side 2	Thistle MultiFinish	Thickness, Side 2 (mm)	2


Technical Specification

This document provides guidance on how to achieve performance and warranty requirements by exclusively using British Gypsum products or system specifications.

GypWall Resilient

Q606040S (EN)

Inner layer of Gyproc FireLine 15mm with an outer layer of Gyproc DuraLine 15mm each side of Gypframe 70 S 50 'C' Studs at 600mm centres with Gypframe RB1 Resilient Bar at 600mm centres to one side. 50mm Isover Acoustic Partition Roll (APR 1200) in the cavity with 2mm Thistle MultiFinish on each side. For heights up to 4000mm.

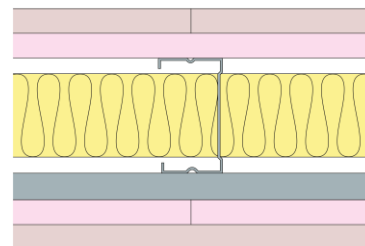

System performance

Please read performance data with any associated standards.

Fire integrity (mins)	120
Maximum height (mm)	4000

The maximum heights quoted are limited by the fire state field of application or by limiting deflection of L/240 at 200 Pa, whichever is the lower of the two.

Sound insulation (Airborne) Rw (dB)	62
-------------------------------------	-----------

Including skim finish to both sides.

Fire insulation (mins)	120
------------------------	------------

Sound insulation (Airborne) Rw + Ctr (dB)	53
---	-----------

Duty rating	Severe
Partition thickness (mm)	151
Approx. weight (kg/m ²)	53

Standards

These standards relate to the above performance data.

BS EN 1364-1, Fire resistance tests for non-loadbearing elements - Walls.

BS 5234-2, Specification for performance requirements for strength and robustness including methods of test.

BS EN ISO 10140-2, Acoustics - Laboratory measurement of sound insulation of building elements. Measurement of airborne sound insulation.

Further information

SpecSure® system performance warranty confirms that British Gypsum proprietary systems will perform as specified for the lifetime of the building. The **SpecSure®** warranty requires that all components are specified in full and constructed in accordance with British Gypsum's installation guidance. For more details see the British Gypsum website. Always check with the design team before making any changes to the chosen specification, ensuring appropriate substantiation is sought to confirm that the solution still meets all required project performances.