


# Technical Specification

This document provides guidance on how to achieve performance and warranty requirements by exclusively using British Gypsum products or system specifications.

## GypLyner Xternal T106030 (EN)

A non-loadbearing external wall construction including a 20mm deflection head with one layer of Glasroc X Sheathing Board 12.5mm to external side and three layers of Gyproc FireLine 15mm to the internal side of 100mm SFS framework. 100mm Isover Steel Frame Infill Batt in the cavity. For heights up to 4000mm.

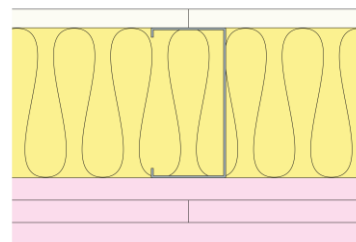

## Head design

Head channel	<b>104mm Hadley SFS Channel</b>
SFS slotted channel (104mm x 70mm x 2.0mm) suitably fixed to soffit at 600mm centres.	
Deflection allowance	For vertical movement up to 20mm. To be determined by a Structural Engineer.
Dropped soffit	For principles of deflection head construction refer to detail ST-225-ZZL3-02

## Framework

Stud	<b>100mm Hadley SFS Stud</b>
Stud centres - Max (mm)	600
Stud fixing	<b>British Gypsum Wafer Head Jack-Point Screws 13mm</b>

SFS studs (100mm x 50mm x 1.2mm) should be cut 25mm short and engaged into the slotted head channel and fixed through the slots with British Gypsum Wafer Head Jack-Point Screws 13mm each side of stud (25mm below the top of the slot)

Abutments and openings	<b>100mm Hadley SFS Stud</b>
SFS stud (100mm x 50mm x 1.2mm) suitably fixed to structure at 600mm centres.	

Base channel	<b>104mm Hadley SFS Channel</b>
SFS channel (104mm x 40mm x 1.2mm) suitably fixed to floor at 600mm centres. All SFS components are supplied direct from Hadley Group.	

## Insulation

Insulation, Layer 1	<b>100mm Isover Steel Frame Infill Batt</b>
---------------------	---

## Board and fixings

Board side 1, Layer 1	<b>Gyproc FireLine 15mm</b>	Screws side 1, Layer 1	<b>British Gypsum Jack-Point Screws 25mm</b>
Board side 1, Layer 2	<b>Gyproc FireLine 15mm</b>	Screws side 1, Layer 2	<b>British Gypsum Jack-Point Screws 41mm</b>
Board side 1, Layer 3	<b>Gyproc FireLine 15mm</b>	Screws side 1, Layer 3	<b>British Gypsum Jack-Point Screws 60mm</b>
Board side 2, Layer 1	<b>Glasroc X Sheathing Board 12.5mm</b>	Screws side 2, Layer 1	<b>Glasroc X Screws 25mm</b>

Board side 1, Layer 1 (inner) and Layer 2 (middle), fix securely to SFS supports around the perimeter of the board at maximum 300mm centres except the head channel; Board side 1, Layer 3 (outer), fix securely to all SFS supports around the perimeter of the board and intermediate stud positions at maximum 300mm centres except the head channel. The uppermost board fixings are positioned 130mm below the structural soffit through board in to fixing strap. Board side 2, Layer 1, fix securely to all SFS supports around the perimeter of the board and intermediate stud positions at maximum 300mm centres except the head channel. The uppermost board fixings are positioned 130mm below the structural soffit. External corners reduce fixings to 200mm. All joints staggered between layers. First fixing of the external board into the stud should be 100mm above the floor channel leg and then fixed working up the stud (board side 2). Fix working from the centre of each board on the internal side (board side 1). Position screws not less than 13mm from cut edges and 10mm from bound edges of boards. Set screw heads flush with plasterboard surface; do not break gypsum core.

Fixing strap	<b>Gypframe GFS1 Fixing Strap</b>
Used to support horizontal board joints to internal side and enable board screw fixing at 300mm centres.	

Sealant	<b>Gyproc Sealant</b>
On the internal side, locate sealant at junctions with adjoining structure and other air paths. Apply as a continuous bead to clean, dry, dust-free surfaces, leaving no gaps. After application of sealant, bulk fill gaps between floor and underside of plasterboard using Gyproc joint compound.	

External board joints	<b>Glasroc X Sealant</b>
Apply a continuous 6mm bead of Glasroc X Sealant along vertical and horizontal edges of board where boards will abut each other. Push the sheathing board up to the previous board ensuring the sealant 'mushroomed' out fully sealing the joint.	

## External Insulation

*No external insulation*

## Finish coat

To achieve the specified performances, the system should be finished using either one of our Thistle or ThistlePro plasters, or Gyproc jointing products to the internal face. See the product range guides on the British Gypsum website for more information.


# Technical Specification

This document provides guidance on how to achieve performance and warranty requirements by exclusively using British Gypsum products or system specifications.

GypLyner Xternal

## T106030 (EN)

A non-loadbearing external wall construction including a 20mm deflection head with one layer of Glasroc X Sheathing Board 12.5mm to external side and three layers of Gyproc FireLine 15mm to the internal side of 100mm SFS framework. 100mm Isover Steel Frame Infill Batt in the cavity. For heights up to 4000mm.

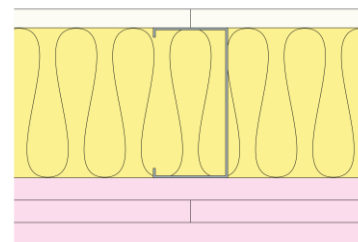

## System performance

Please read performance data with any associated standards.

Fire integrity (mins)	<b>120</b>
Maximum height (mm)	<b>4000</b>

Fire insulation (mins)	<b>120</b>
------------------------	------------

The maximum heights quoted are limited by the fire state field of application or by limiting deflection of L/240 at 200 Pa, whichever is the lower of the two.

Approx. weight (kg/m <sup>2</sup> )	<b>52</b>
Loadbearing	<b>No</b>

## Standards

These standards relate to the above performance data.

BS EN 1364-1, Fire resistance tests for non-loadbearing elements - Walls.

## Further information

**SpecSure®** system performance warranty confirms that British Gypsum proprietary systems will perform as specified for the lifetime of the building. The **SpecSure®** warranty requires that all components are specified in full and constructed in accordance with British Gypsum's installation guidance. For more details see the British Gypsum website. Always check with the design team before making any changes to the chosen specification, ensuring appropriate substantiation is sought to confirm that the solution still meets all required project performances.