



Report Number **BTC16071A**

An acoustic test report covering laboratory sound insulation testing to BS EN ISO 140-3:1995 on a Gypwall QUIET IWL twin frame 200mm overall partition incorporating Gypwall 48I50 studs at 600mm centres with a double layer of 15mm SoundBloc each side and 50mm Isover APR 1200 in the cavity.

Test Date: 5th November 2008.

Report Amended 10th November 2008

Customer: **British Gypsum Limited**
East Leake
Loughborough
Leicestershire
LE12 6HX

Customer: **British Gypsum Limited**

BTC 16071A: Page 1 of 11



0296



TABLE OF CONTENTS

FOREWORD 3

REPORT AUTHORISATION 3

TEST CONSTRUCTION 4

H16071AA 4

TEST MATERIALS 6

Plasterboard 6

Insulation..... 6

Metal Components..... 6

Fasteners 7

Miscellaneous Components 7

TEST RESULTS 8

TEST PROCEDURE 8

LIMITATIONS 8

APPENDIX A - TEST DATA 9

APPENDIX B - TEST METHOD AND CONDITIONS..... 11



FOREWORD

The test sponsor was British Gypsum Limited.

The test specimen was installed by Pete Rigley on the 5th November 2008.

The Building Test Centre played no role in the design or selection of the materials comprising the test specimen.

REPORT AUTHORISATION

Report Author



Jeremy Simons
M.Sci (hons) AMInstP AMIOA
Technologist

Authorised by



James Stonell
AMIOA
Technologist

The Building Test Centre will not discuss the content of this report without written permission from the test sponsor. The Building Test Centre retains ownership of the test report content but authorises the test sponsor to reproduce the report as necessary in its entirety only.

TEST CONSTRUCTION

H16071AA

The test specimen was constructed in the aperture having an overall opening of 2400mm (high) x 3600mm (wide).

Gypframe 50 C 50 Standard Floor & Ceiling channels were fixed to the head and base of the test aperture using 25mm Gyproc drywall screws at 600mm centres.

Gypframe 48 C 50 'C' Studs were screw fixed to either side of the test aperture using 25mm Gyproc drywall screws at 600mm centres.

Gypframe 48 I 50 'I' Studs were inserted between the head and base channels at 600mm centres.

A second framework using the same components and fixing details was located to create the twin frame, and a final partition thickness of 200mm. The 48 I 50 'I' Studs were located at 600mm centres parallel with the first set of framework studs.

50mm Isover Acoustic Partition Roll 1200 was positioned in the partition cavity.

Both sides of the framework were clad in a double layer of 15mm Gyproc SoundBloc board.

The inner layer was fixed using 32mm Gyproc Drywall screws around the perimeter of the board at 300mm centres.

The outer layer was screw fixed around the perimeter of the board and to the intermediate studs using 42mm Gyproc Drywall screws at 300mm centres.

All joints were staggered between layers.

The perimeter of the partition was sealed to the test aperture with Gyproc Sealant. The board joints and screw heads we covered with tape.

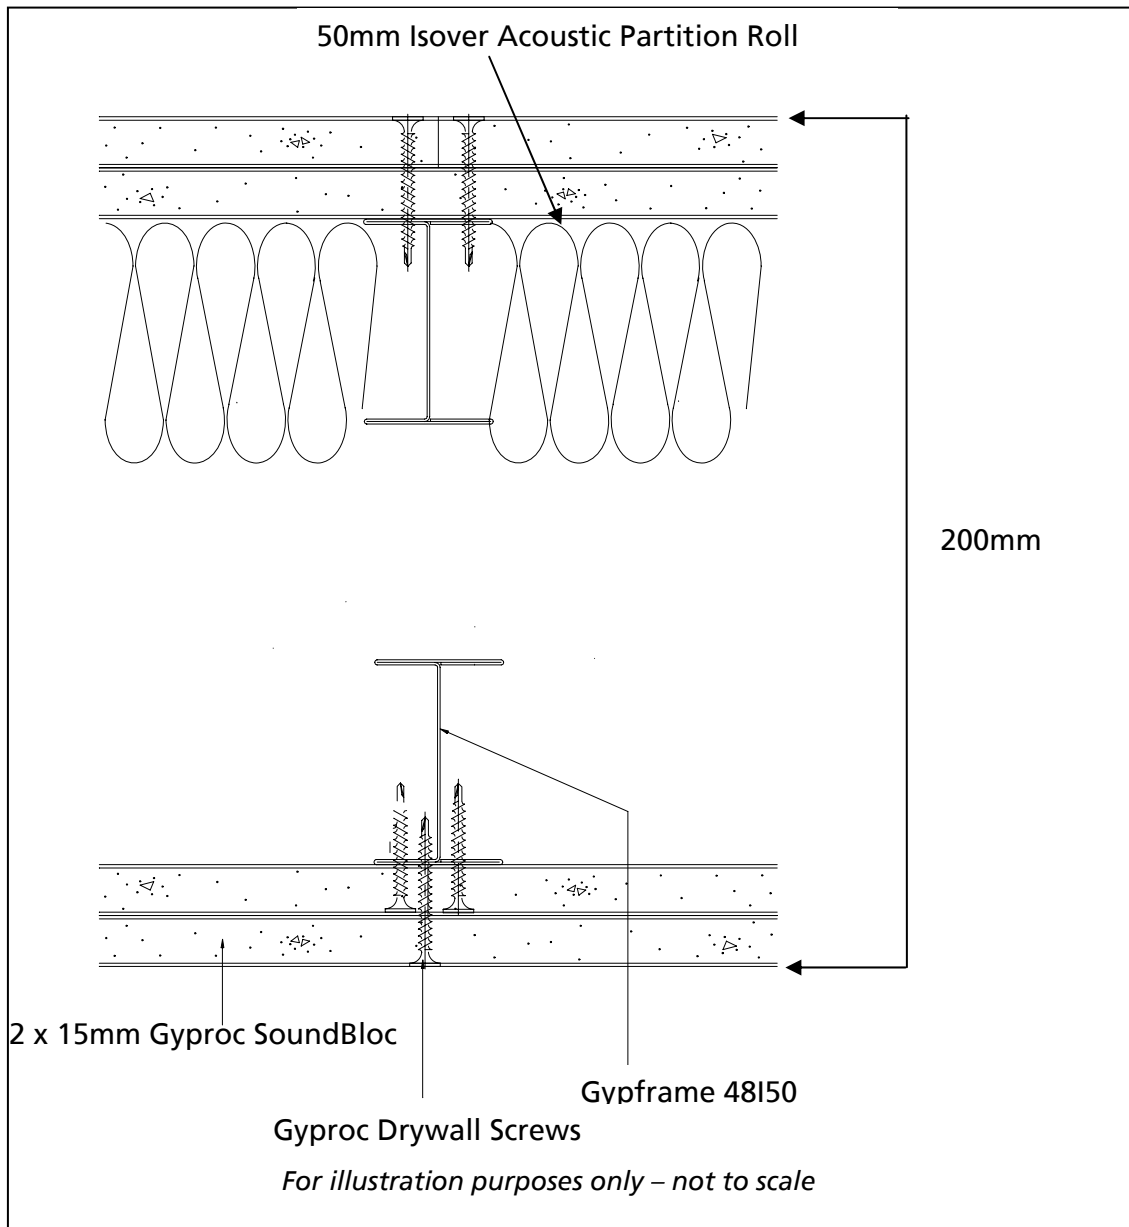


Figure 1. Cross section of BTC 16071A

The descriptions of individual components making up the test specimen were provided by the customer and were checked for accuracy wherever possible.

TEST MATERIALS

Plasterboard

- i) Nominally 2400mm (long) x 1200mm (wide) x 15mm (thick) Gyproc SoundBloc manufactured by British Gypsum Limited, ex East Leake.

Surface density:	13.32 kg/m ²
Average thickness:	14.98 mm
Board Code:	16 303 8 23:48

The surface densities were calculated using the actual weight and size of a selection of the boards used in the test specimen.

Insulation

- i) Nominally 50mm thick Isover APR insulation supplied by Saint Gobain Isover.

Average area	15.60 m ²
Average weight	10.02 Kg
Density	12.85 Kg/m ³

The density was calculated using the actual weight and size of the insulation used in the test specimen.

Metal Components

- i) 0.5mm thick Gypframe 48I50 'I' Studs.
ii) 0.5mm thick Gypframe 48C50 'C' Studs
iii) 0.5mm thick Gypframe 50C50 Standard Flange Floor & Ceiling Channel.

All metal components are manufactured from galvanised mild steel using the 'UltraSTEEL' process and supplied by British Gypsum Limited.

All metal components are supplied by British Gypsum Limited.

Customer: **British Gypsum Limited**

Fasteners

- i) 25mm Gyproc drywall screws
- ii) 32mm Gyproc drywall screws
- iii) 42mm Gyproc drywall screws

All fasteners supplied by British Gypsum Limited

Miscellaneous Components

- i) Gyproc Sealant supplied by British Gypsum Limited
- ii) Joint tape supplied by The Building Test Centre

Where measurements could not be taken, then weight and dimensions were provided by the customer or the manufacturer e.g. from material labelling. Material information was recorded according to procedure MAT/1.

TEST RESULTS

Test Code	Description	Weighted Airborne Sound Reduction Index R_w (C; Ctr)
H16071AA	200mm Gypwall Quiet IWL comprising a double layer of 15mm SoundBloc (ex East Leake) with 50mm Isover APR 1200 in the cavity.	66 (-3;-8)dB

For full data see data in Appendix A of this report.

Test conducted in accordance with BS EN ISO 140-3: 1995 except for Clause F.2 where minimum distances for measurements at frequencies under 100Hz can not be met.

Rated in accordance with BS EN ISO 717-1: 1997

TEST PROCEDURE

The test specimen (3.6 m x 2.4 m) was constructed in a wall dividing two reverberant rooms of approximately 98m³ and 62m³. The accuracy of the test method conforms to BS EN 20140-2:1993, the test procedure used is detailed in the test data in Appendix A of this report. Broad-band white noise was used to measure the level differences and broad-band pink noise was used to measure the reverberation times. Third octave band pass filters were used in real time mode. See appendix B for further information.

LIMITATIONS

The results only relate to the behaviour of the element of construction under the particular conditions of test; they are not intended to be the sole criteria for assessing the potential acoustic performance of the element in use nor do they reflect the actual behaviour.

The specification and interpretation of test methods are subject to ongoing development and refinement. Changes in associated legislation may also occur. For these reasons it is recommended that the relevance of test reports over 5 years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test to ensure that they are consistent with current practices, and if required may endorse the test report.

Customer: **British Gypsum Limited**

BTC 16071A: Page 8 of 11




0296

APPENDIX A - TEST DATA

Test Code: H16071AA
Test Date: 05/11/2008

Freq. Hz	R dB
50	30.7
63	29.5
80	35.7
100	44.3
125	41.6
160	48.1
200	52.9
250	55.4
315	60.6
400	64.8
500	65.9
630	66.8
800	69.6
1 000	75.6
1 250	79.2
1 600	82.1
2 000	82.4
2 500	71.6
3 150	72.2
4 000	79.1
5 000	82.7
6 300	
8 000	
10 000	

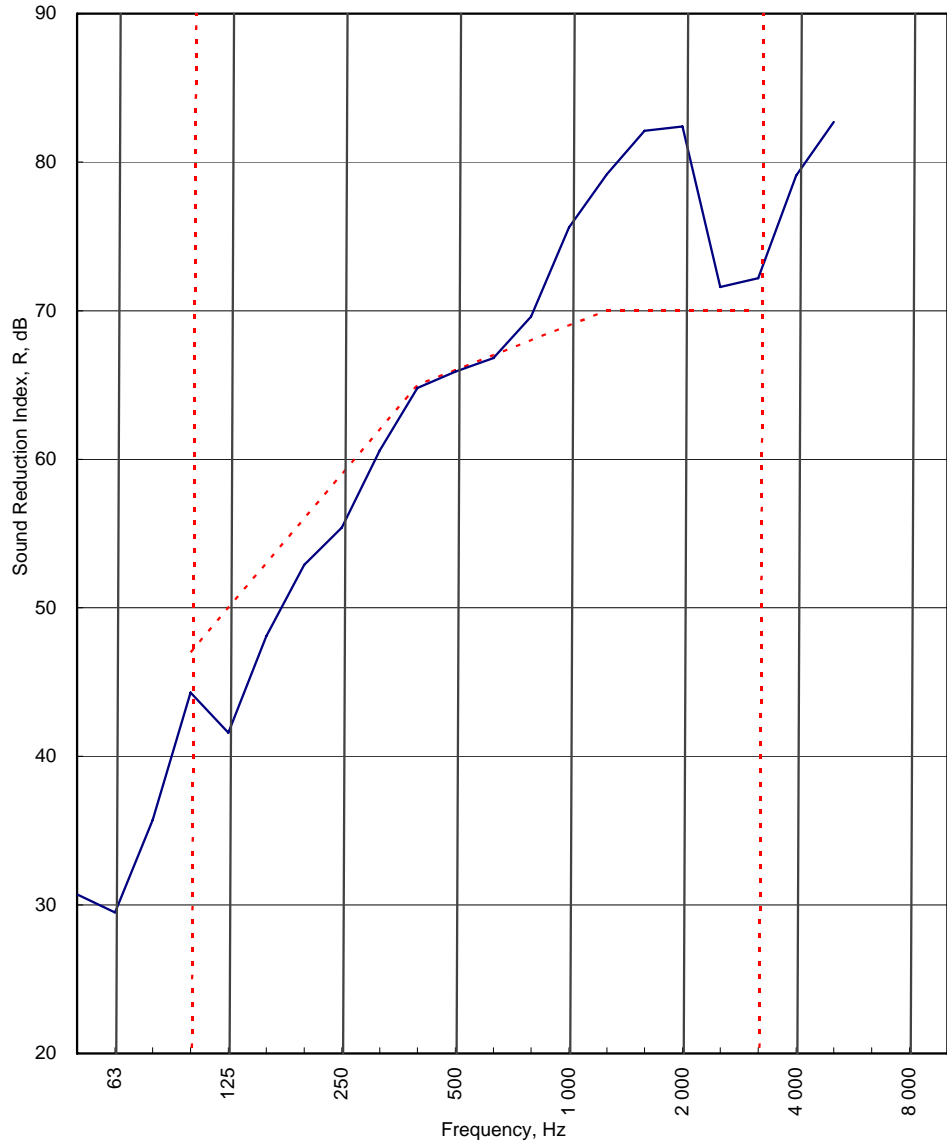

----- Curve of reference values (ISO 717-1)

Rating according to BS EN ISO 717-1:1997 Evaluation based on laboratory measurement results obtained by an engineering method:	R_w (C;C_{tr}) = 66 (-3;-8) dB		
	Max dev. 8.4 dB at 125 Hz		
	C₅₀₋₃₁₅₀ = -6 dB	C₅₀₋₅₀₀₀ = -5 dB	C₁₀₀₋₅₀₀₀ = -2 dB
	C_{tr,50-3150} = -17 dB	C_{tr,50-5000} = -17 dB	C_{tr,100-5000} = -8 dB

Customer: **British Gypsum Limited**



LABORATORY AIRBORNE SOUND INSULATION TEST - BS EN ISO 140-3:1995

Test Code: **H16071AA**

Test Date: **05/11/2008**

Specimen Area, S = **8.64** m²

	Room T2	Room T1
Room Volume, m ³ :	98	59.27
Temperature, deg.C:	14.3	13.8
Rel. Humidity, %RH:	64	67.7

Freq Hz	Test Room T2 to Test Room T1						R dB	U.Dev. dB	R 1/1Oct dB
	Source dB	Rec. (uc) dB	Bgrnd dB	Rec. (corr) dB	Rev.time Sec	Corr. dB			
50	63.2	30.3	25.5	29.0	0.49	-3.5	30.7		
63	63.1	31.7	14.4	31.7	0.71	-1.9	29.5		31.3
80	72.4	34.7	8.6	34.7	0.69	-2.0	35.7		
100	83.6	38.9	14.7	38.9	0.99	-0.4	44.3	2.7	
125	106.9	65.1	11.3	65.1	1.04	-0.2	41.6	8.4	43.9
160	87.1	39.5	8.9	39.5	1.24	0.5	48.1	4.9	
200	92.2	40.2	16.0	40.2	1.35	0.9	52.9	3.1	
250	94.1	39.8	7.7	39.8	1.42	1.1	55.4	3.6	55.3
315	93.8	34.7	10.1	34.7	1.56	1.5	60.6	1.4	
400	92.8	29.1	10.4	29.1	1.42	1.1	64.8	0.2	
500	91.0	25.8	4.7	25.8	1.29	0.7	65.9	0.1	65.8
630	90.1	24.3	3.6	24.3	1.38	1.0	66.8	0.2	
800	90.6	22.2	6.1	22.2	1.44	1.2	69.6		
1 000	108.8	34.5	13.1	34.5	1.48	1.3	75.6		73.0
1 250	108.4	30.7	7.0	30.7	1.56	1.5	79.2		
1 600	110.5	29.8	9.4	29.8	1.53	1.4	82.1		
2 000	111.7	30.7	10.6	30.7	1.50	1.4	82.4		75.7
2 500	109.2	38.5	8.9	38.5	1.35	0.9	71.6		
3 150	107.8	36.3	10.0	36.3	1.28	0.7	72.2		
4 000	106.8	28.3	12.7	28.3	1.25	0.6	79.1		75.9
5 000	106.5	24.4	11.6	24.2	1.20	0.4	82.7		
6 300									
8 000									
10 000									

Single Figure Ratings	Rw	C	Ctr	Total U. Dev., dB	24.6
BS EN ISO 717-1: 1997	dB	dB	dB		
	66	-3	-8		
	(100-5000)	-2	-8		
Background Corrected					
	(50-3150)	-6	-17		
	(50-5000)	-5	-17		
				Procedure: ISO140/3/B - issue 2	
				Worksheet: 140_3_1.XLS	



APPENDIX B - TEST METHOD AND CONDITIONS

The source room (T2) was treated with six perspex diffusers of approximately 900mm x 1220mm. An omni-directional loudspeaker sound source is placed near a back corner of the source room (T2), rotating at 1 rpm and at least 0.7m from any room boundary to satisfy Annex C of BS EN ISO 140-3: 1995. A stationary loudspeaker sound source is placed in the corner of the receiving room (T1) opposite the test specimen.

The average sound pressure level in each 1/3 octave band is measured using a rotating microphone boom, positioned such that the minimum distance between microphone and sound source is 1m and between microphone and room boundaries is 0.7m. The rotating microphone has a sweep radius of at least 1m and is inclined in relation to the boundaries at an angle of at least 30° to the horizontal. The microphone has a traverse time of 32 seconds, and the sound pressure levels are averaged over 64 seconds which is equivalent to two complete sweeps of the microphone boom.


The equivalent absorption area of the receiving room is determined by producing the arithmetic average of twelve reverberation times and applying this to the Sabine formula.

The test specimen is installed in the aperture so that it finishes flush with the first independent timber in room T2 side to eliminate indirect transmission between rooms. The specimen is not installed so that the aperture depth ratio 2:1 is met as recommended in section 5.2.1 of BS EN ISO 140-3:1995. Laboratory tests have been carried out to prove the insignificance of this installation position on the test results.

The laboratory limit for measurement due to flanking is (combined BTC 11709A, BTC13562EA, BTC 15398A and BTC 15829A)

Freq Hz	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000
R _{max}	45.0	46.9	58.5	62.4	62.9	67.7	71.2	77.2	84.2	92.0	97.7	101.5	103.8	97.6	102.4	104.8	101.8	102.9	98.7	96.4	96.2

The figure below shows flanking and isolation treatments in the test chamber.

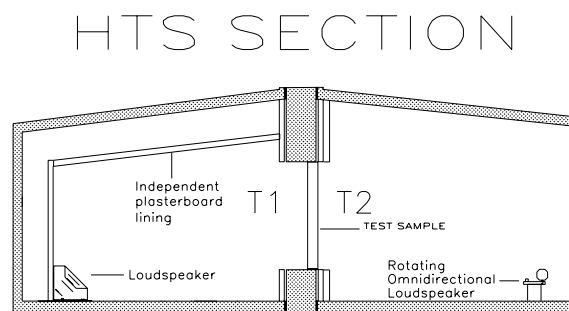

Chamber layout

Customer: **British Gypsum Limited**

BTC 16071A: Page 11 of 11



0296