



# The Building Test Centre

Fire Acoustics Structures

The Building Test Centre  
British Gypsum  
East Leake  
Loughborough  
Leics. LE12 6NP  
Tel (0115) 945 1564  
Fax (0115) 945 1562  
Email [btc.testing@bpb.com](mailto:btc.testing@bpb.com)  
Website [www.btconline.co.uk](http://www.btconline.co.uk)

## Report Number **BTC16499A**

An acoustic test report covering laboratory sound insulation testing to BS EN ISO 140-3:1995 on a British Gypsum Gypwall Classic partition clad with a single layer of 15mm SoundBloc with 25mm Isover APR insulation in the cavity.

Test Date: 12<sup>th</sup> June 2009

[www.btconline.co.uk](http://www.btconline.co.uk)

Customer: **British Gypsum**  
East Leake  
Loughborough  
Leicestershire  
LE12 6HX

Customer: **British Gypsum**

BTC 16499A: Page 1 of 13



0296



**TABLE OF CONTENTS**

**FOREWORD ..... 3**

**REPORT AUTHORISATION ..... 3**

**TEST CONSTRUCTION ..... 4**

**TEST MATERIALS ..... 6**

*Plasterboard ..... 6*

*Insulation..... 6*

*Metal Components..... 6*

*Fasteners ..... 6*

*Miscellaneous Components ..... 7*

**TEST RESULTS ..... 8**

**TEST PROCEDURE ..... 8**

**LIMITATIONS ..... 8**

**APPENDIX A - TEST DATA ..... 9**

**APPENDIX B - TEST METHOD AND CONDITIONS..... 13**



## FOREWORD

The test sponsor was British Gypsum.

The test specimens were installed by Liam Woodford and John Gwynne on the 12<sup>th</sup> June 2009.

The Building Test Centre played no role in the design or selection of the materials comprising the test specimen.

## REPORT AUTHORISATION

Report Author



**Jeremy Simons**  
M.Sci AmlnstP AMIOA  
*Technologist*

Authorised by



**Christopher Mutton**  
M.Phys  
*Technologist*

The Building Test Centre will not discuss the content of this report without written permission from the test sponsor. The Building Test Centre retains ownership of the test report content but authorises the test sponsor to reproduce the report as necessary in its entirety only.

## TEST CONSTRUCTION

The test specimen was constructed in an aperture having an overall opening of 2400mm (high) x 3600mm (wide).

Gypframe 94C50 Floor & Ceiling Channels were fixed to the head and base of the aperture using 25mm Gyproc drywall screw fixings spaced at 600mm centres.

Gypframe 92S50 'C' Studs were positioned between the head and base channels at each end of the aperture and fixed using 25mm Gyproc drywall screw fixings spaced at 600mm centres.

Gypframe 92A550 Acoustuds were positioned between the head and base channels at 600mm centres.

25mm Isover APR insulation was placed within the stud cavity.

The framework was clad with a single layer of 15mm SoundBloc.


The boards were screw fixed around the perimeter of the board and the intermediate stud positions at 300mm centres using 32mm Gyproc drywall screws.

All vertical joints were staggered between layers. All joints were taped and the perimeter sealed with Gyproc Sealant.

Following the test the insulation was removed from the cavity before the returning the boards to the framework. The joints were taped and the perimeter resealed with Gyproc Sealant before repeating the test.

| Test | No. of layers and Board Type | No. of layers and Insulation Type |
|------|------------------------------|-----------------------------------|
| A    | 1 x 15mm SoundBloc           | 1 x 25mm Isover APR               |
| B    | 1 x 15mm SoundBloc           | NO INSULATION                     |

**Table 1.** Details of board specifications and insulation used in the test series.

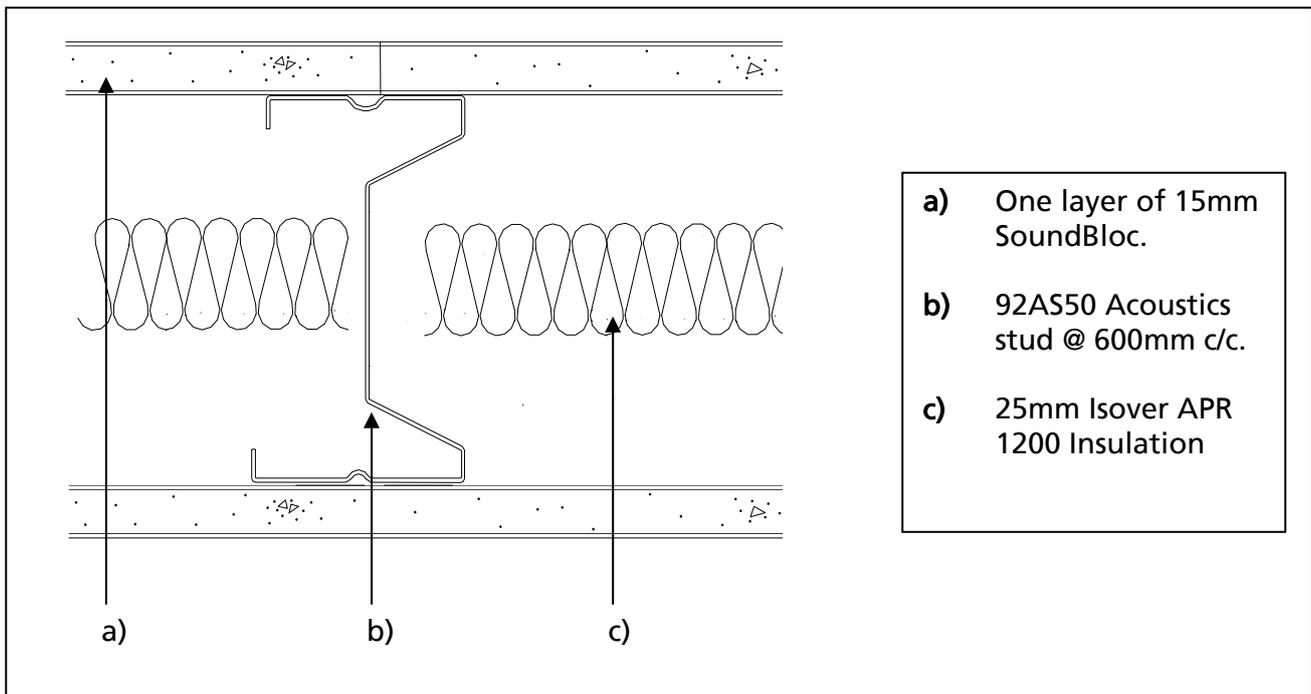

**Figure 1.** Horizontal cross section view through partition BTC16499AA.

*The descriptions of individual components making up the test specimen were provided by the customer and were checked for accuracy wherever possible.*

## TEST MATERIALS

### Plasterboard

- i) Nominally 2400mm (long) x 1200mm (wide) x 15mm (thick) Gyproc SoundBloc manufactured by British Gypsum, ex East Leake.

|                    |                         |
|--------------------|-------------------------|
| Surface density:   | 13.64 kg/m <sup>2</sup> |
| Average thickness: | 14.99 mm                |
| Board Code:        | 16 141 9 02:10          |

The surface densities were calculated using the actual weight and size of a selection of the boards used in the test specimen.

### Insulation

- i) Nominally 25mm thick Isover APR insulation supplied by Saint Gobain Isover.

|                |                         |
|----------------|-------------------------|
| Average area   | 24.00 m <sup>2</sup>    |
| Average weight | 10.10 kg                |
| Density        | 16.83 kg/m <sup>3</sup> |

The density was calculated using the actual weight and size of the insulation used in the test specimen.

### Metal Components

- i) 0.5mm thick Gypframe 92A50 AcouStud.  
ii) 0.5mm thick Gypframe 92S50 'C' Studs.  
iii) 0.5mm thick Gypframe 94C50 Floor & Ceiling Channel.

All metal components are manufactured from galvanised mild steel using the 'UltraSTEEL' process and supplied by British Gypsum.

### Fasteners

- i) 25mm Gyproc drywall screws  
ii) 32mm Gyproc drywall screws

All fasteners supplied by British Gypsum

Customer: **British Gypsum**

BTC 16499A: Page 6 of 13



0296

---

Miscellaneous Components

- i) Gyproc Sealant supplied by British Gypsum
- ii) Joint tape supplied by The Building Test Centre

Where measurements could not be taken, then weight and dimensions were provided by the customer or the manufacturer e.g. from material labelling. Material information was recorded according to procedure MAT/1.

## TEST RESULTS

| Test Code | Description  | Weighted Airborne Sound Reduction Index $R_w$ (C; Ctr) |
|-----------|--|--|
| H16499AA  | Single layer of 15mm SoundBloc with 25mm APR within the cavity | 50 (-3; -7) dB   |
| H16499BA  | Single layer of 15mm SoundBloc                                 | 45 (-2; -6) dB   |

For full data see data in Appendix A of this report.

Test conducted in accordance with BS EN ISO 140-3: 1995 except for Clause F.2 where minimum distances for measurements at frequencies under 100Hz can not be met.

Rated in accordance with BS EN ISO 717-1: 1997

## TEST PROCEDURE

The test specimen (3.6 m x 2.4 m) was constructed in a wall dividing two reverberant rooms of approximately 98m<sup>3</sup> and 62m<sup>3</sup>. The accuracy of the test method conforms to BS EN 20140-2:1993, the test procedure used is detailed in the test data in Appendix A of this report. Broad-band white noise was used to measure the level differences and broad-band pink noise was used to measure the reverberation times. Third octave band pass filters were used in real time mode. See appendix B for further information.

## LIMITATIONS

The results only relate to the behaviour of the element of construction under the particular conditions of test; they are not intended to be the sole criteria for assessing the potential acoustic performance of the element in use nor do they reflect the actual behaviour.

The specification and interpretation of test methods are subject to ongoing development and refinement. Changes in associated legislation may also occur. For these reasons it is recommended that the relevance of test reports over 5 years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test to ensure that they are consistent with current practices, and if required may endorse the test report.

Customer: **British Gypsum**

BTC 16499A: Page 8 of 13




0296

**APPENDIX A - TEST DATA**

|                                 |
|---------------------------------|
| Test Code:<br><b>H16499AA</b>   |
| Test Date:<br><b>12/06/2009</b> |

| Freq. Hz | R dB |
|----------|------|
| 50       | 20.0 |
| 63       | 13.4 |
| 80       | 14.5 |
| 100      | 25.7 |
| 125      | 29.1 |
| 160      | 38.3 |
| 200      | 41.7 |
| 250      | 44.1 |
| 315      | 48.0 |
| 400      | 49.0 |
| 500      | 50.5 |
| 630      | 52.6 |
| 800      | 56.5 |
| 1 000    | 58.4 |
| 1 250    | 61.7 |
| 1 600    | 61.3 |
| 2 000    | 56.4 |
| 2 500    | 45.2 |
| 3 150    | 44.0 |
| 4 000    | 48.6 |
| 5 000    | 51.7 |
| 6 300    |      |
| 8 000    |      |
| 10 000   |      |

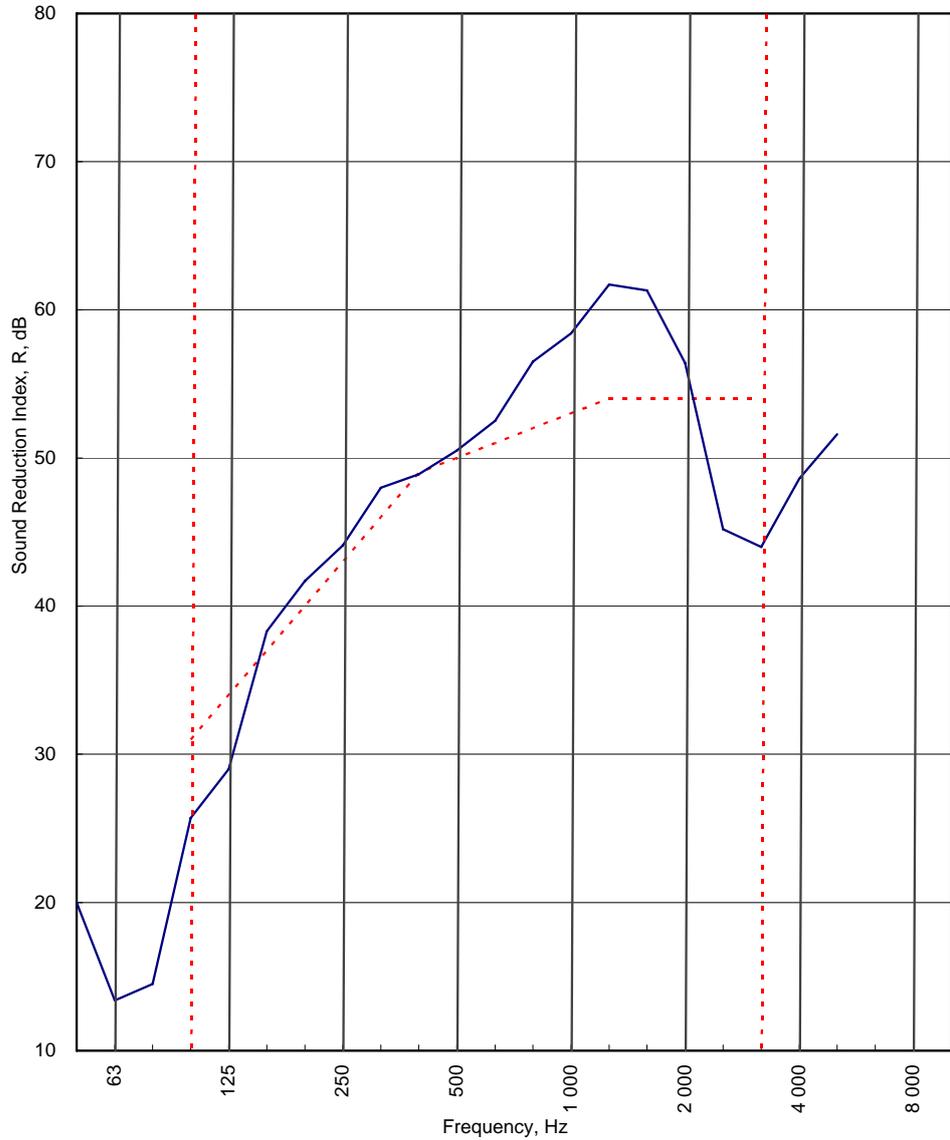

----- Curve of reference values (ISO 717-1)

|   |  |  |  |
|---|--|--|--|
| Rating according to<br>BS EN ISO 717-1:1997   | <b>R<sub>w</sub> (C;Ctr) = 50 (-3;-7) dB</b> |  |  |
|   | <b>Max dev. 10 dB at 3 150 Hz</b>            |  |  |
| Evaluation based on laboratory<br>measurement results obtained by<br>an engineering method: | <b>C<sub>50-3150</sub> = -7 dB</b>           | <b>C<sub>50-5000</sub> = -6 dB</b>     | <b>C<sub>100-5000</sub> = -2 dB</b>    |
|   | <b>C<sub>tr,50-3150</sub> = -18 dB</b>       | <b>C<sub>tr,50-5000</sub> = -18 dB</b> | <b>C<sub>tr,100-5000</sub> = -7 dB</b> |

Customer: **British Gypsum**

BTC 16499A: Page 9 of 13



0296

LABORATORY AIRBORNE SOUND INSULATION TEST - BS EN ISO 140-3:1995

Test Code: **H16499AA**

Test Date: **12/06/2009**

Specimen Area, S = **8.64** m<sup>2</sup>

|                               |             |              |
|-------------------------------|-------------|--------------|
|                               | Room T2     | Room T1      |
| Room Volume, m <sup>3</sup> : | <b>98</b>   | <b>59.93</b> |
| Temperature, deg.C:           | <b>17.4</b> | <b>17.7</b>  |
| Rel. Humidity, %RH:           | <b>45.6</b> | <b>44</b>    |


| Freq<br>Hz | Test Room T2 to Test Room T1 |                 |             |                   |                 |             | R<br>dB | U.Dev.<br>dB | R<br>1/10Oct<br>dB |
|------------|------------------------------|-----------------|-------------|-------------------|-----------------|-------------|---------|--------------|--------------------|
|            | Source<br>dB                 | Rec. (uc)<br>dB | Bgrnd<br>dB | Rec. (corr)<br>dB | Rev.time<br>Sec | Corr.<br>dB |         |              |                    |
| 50         | 64.5                         | 41.7            | 17.0        | 41.7              | 0.58            | -2.8        | 20.0    |              |                    |
| 63         | 63.5                         | 49.2            | 17.3        | 49.2              | 0.90            | -0.9        | 13.4    |              | 15.2               |
| 80         | 71.7                         | 56.5            | 10.1        | 56.5              | 0.94            | -0.7        | 14.5    |              |                    |
| 100        | 84.7                         | 58.2            | 22.9        | 58.2              | 0.92            | -0.8        | 25.7    | 5.3          |                    |
| 125        | 84.2                         | 55.1            | 6.4         | 55.1              | 1.10            | 0.0         | 29.1    | 4.9          | 28.7               |
| 160        | 89.4                         | 51.7            | 2.8         | 51.7              | 1.27            | 0.6         | 38.3    |              |                    |
| 200        | 94.6                         | 53.5            | 12.5        | 53.5              | 1.28            | 0.6         | 41.7    |              |                    |
| 250        | 96.4                         | 53.6            | 2.8         | 53.6              | 1.51            | 1.3         | 44.1    |              | 43.9               |
| 315        | 96.1                         | 49.1            | 6.2         | 49.1              | 1.40            | 1.0         | 48.0    |              |                    |
| 400        | 95.0                         | 47.2            | 11.4        | 47.2              | 1.45            | 1.2         | 49.0    |              |                    |
| 500        | 93.0                         | 43.5            | 3.9         | 43.5              | 1.41            | 1.0         | 50.5    |              | 50.5               |
| 630        | 91.7                         | 40.4            | 1.5         | 40.4              | 1.48            | 1.3         | 52.6    |              |                    |
| 800        | 92.4                         | 37.4            | 4.4         | 37.4              | 1.56            | 1.5         | 56.5    |              |                    |
| 1 000      | 91.8                         | 34.7            | 14.5        | 34.7              | 1.50            | 1.3         | 58.4    |              | 58.4               |
| 1 250      | 92.7                         | 32.4            | 4.0         | 32.4              | 1.53            | 1.4         | 61.7    |              |                    |
| 1 600      | 95.6                         | 35.7            | 4.5         | 35.7              | 1.52            | 1.4         | 61.3    |              |                    |
| 2 000      | 97.4                         | 42.3            | 5.7         | 42.3              | 1.51            | 1.3         | 56.4    |              | 49.6               |
| 2 500      | 96.0                         | 51.5            | 6.4         | 51.5              | 1.31            | 0.7         | 45.2    | 8.8          |                    |
| 3 150      | 95.3                         | 51.8            | 7.5         | 51.8              | 1.24            | 0.5         | 44.0    | 10.0         |                    |
| 4 000      | 97.0                         | 48.7            | 10.6        | 48.7              | 1.20            | 0.3         | 48.6    |              | 47.0               |
| 5 000      | 100.9                        | 49.4            | 10.6        | 49.4              | 1.15            | 0.2         | 51.7    |              |                    |
| 6 300      |                              |                 |             |                   |                 |             |         |              |                    |
| 8 000      |                              |                 |             |                   |                 |             |         |              |                    |
| 10 000     |                              |                 |             |                   |                 |             |         |              |                    |

|                                   |                   |           |            |                                 |           |
|-----------------------------------|-------------------|-----------|------------|---------------------------------|-----------|
| <b>Single Figure Ratings</b>      | <b>Rw</b>         | <b>C</b>  | <b>Ctr</b> | <b>Total U. Dev., dB</b>        | <b>29</b> |
| <b>BS EN ISO 717-1: 1997</b>      | <b>dB</b>         | <b>dB</b> | <b>dB</b>  |                                 |           |
|                                   | <b>50</b>         | <b>-3</b> | <b>-7</b>  |                                 |           |
|                                   | <b>(100-5000)</b> | <b>-2</b> | <b>-7</b>  |                                 |           |
|                                   | <b>(50-3150)</b>  | <b>-7</b> | <b>-18</b> |                                 |           |
| <b>RT's &gt; factor 1.5 apart</b> | <b>(50-5000)</b>  | <b>-6</b> | <b>-18</b> |                                 |           |
|                                   |                   |           |            | Procedure: ISO140/3/B - issue 2 |           |
|                                   |                   |           |            | Worksheet: 140_3_1.XLS          |           |



Test Code:  
H16499BA  
Test Date:  
12/06/2009

| Freq. Hz | R dB |
|----------|------|
| 50       | 22.2 |
| 63       | 13.0 |
| 80       | 13.7 |
| 100      | 23.3 |
| 125      | 23.5 |
| 160      | 32.6 |
| 200      | 38.0 |
| 250      | 37.5 |
| 315      | 39.3 |
| 400      | 43.3 |
| 500      | 47.2 |
| 630      | 47.9 |
| 800      | 52.2 |
| 1 000    | 55.1 |
| 1 250    | 58.3 |
| 1 600    | 58.2 |
| 2 000    | 53.1 |
| 2 500    | 42.3 |
| 3 150    | 41.6 |
| 4 000    | 46.8 |
| 5 000    | 50.4 |
| 6 300    |      |
| 8 000    |      |
| 10 000   |      |

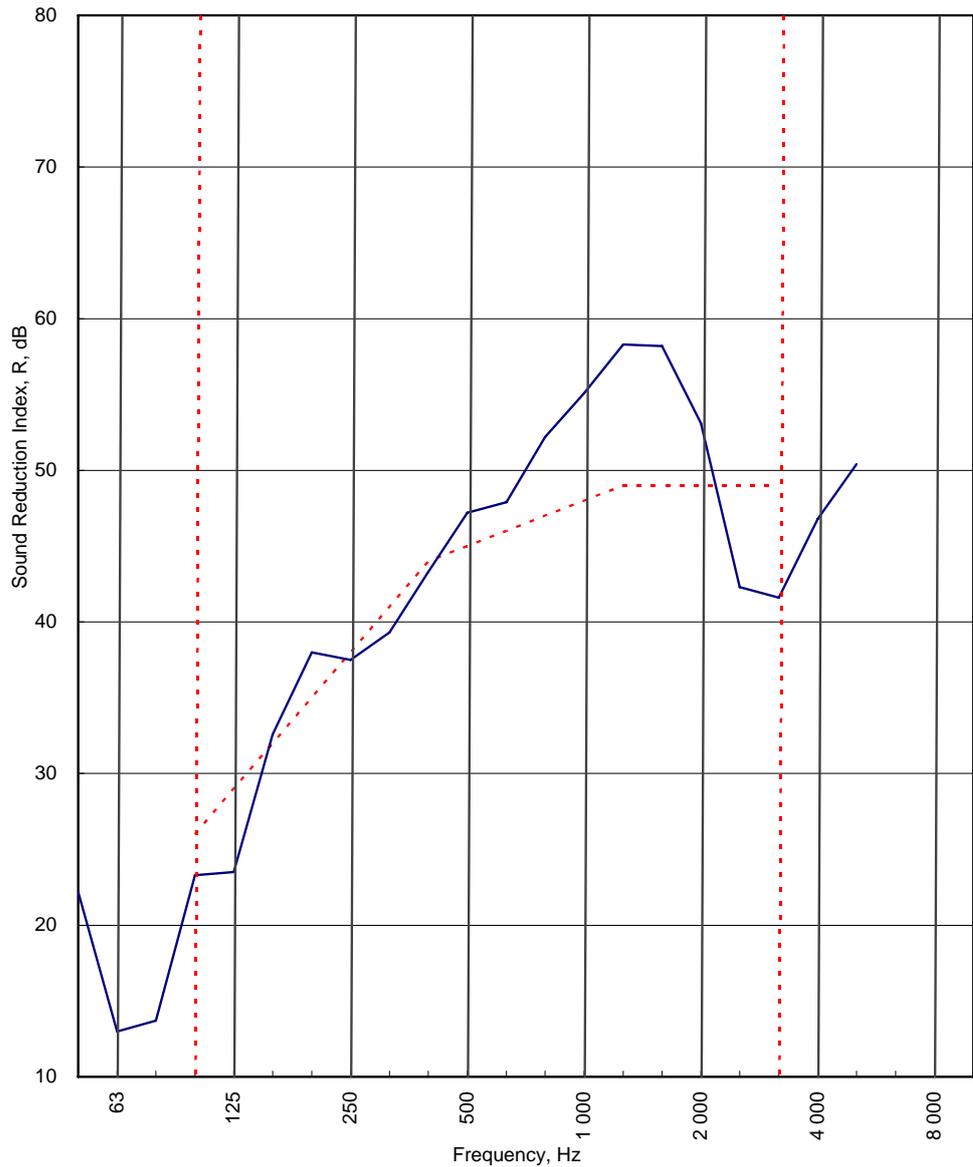

----- Curve of reference values (ISO 717-1)

Rating according to  
BS EN ISO 717-1:1997

**R<sub>w</sub> (C;Ctr) = 45 (-2;-6) dB**

Max dev. 7.4 dB at 3 150 Hz

Evaluation based on laboratory  
measurement results obtained by  
an engineering method:

C<sub>50-3150</sub> = **-4 dB**

C<sub>50-5000</sub> = **-3 dB**

C<sub>100-5000</sub> = **-1 dB**

C<sub>tr,50-3150</sub> = **-14 dB**

C<sub>tr,50-5000</sub> = **-14 dB**

C<sub>tr,100-5000</sub> = **-6 dB**

Customer: **British Gypsum**

BTC 16499A: Page 11 of 13



0296

**LABORATORY AIRBORNE SOUND INSULATION TEST - BS EN ISO 140-3:1995**

Test Code: **H16499BA**

Test Date: **12/06/2009**

Specimen Area, S = **8.64** m<sup>2</sup>

|                               |             |              |
|-------------------------------|-------------|--------------|
|                               | Room T2     | Room T1      |
| Room Volume, m <sup>3</sup> : | <b>98</b>   | <b>59.93</b> |
| Temperature, deg.C:           | <b>18.9</b> | <b>18.3</b>  |
| Rel. Humidity, %RH:           | <b>46.3</b> | <b>45.9</b>  |

| Freq<br>Hz | Test Room T2 to Test Room T1 |                 |             |                   |                 |             | R<br>dB     | U.Dev.<br>dB | R<br>1/1Oct<br>dB |
|------------|------------------------------|-----------------|-------------|-------------------|-----------------|-------------|-------------|--------------|-------------------|
|            | Source<br>dB                 | Rec. (uc)<br>dB | Bgrnd<br>dB | Rec. (corr)<br>dB | Rev.time<br>Sec | Corr.<br>dB |             |              |                   |
| 50         | 65.7                         | 41.4            | 16.2        | 41.4              | 0.69            | -2.1        | <b>22.2</b> |              |                   |
| 63         | 64.8                         | 50.5            | 16.4        | 50.5              | 0.83            | -1.3        | <b>13.0</b> |              | 14.8              |
| 80         | 72.6                         | 58.9            | 10.1        | 58.9              | 1.11            | 0.0         | <b>13.7</b> |              |                   |
| 100        | 85.3                         | 61.3            | 23.7        | 61.3              | 0.94            | -0.7        | <b>23.3</b> | 2.7          |                   |
| 125        | 83.7                         | 59.7            | 7.9         | 59.7              | 0.99            | -0.5        | <b>23.5</b> | 5.5          | 24.9              |
| 160        | 89.7                         | 57.6            | 3.3         | 57.6              | 1.25            | 0.5         | <b>32.6</b> |              |                   |
| 200        | 94.2                         | 57.1            | 11.3        | 57.1              | 1.35            | 0.9         | <b>38.0</b> |              |                   |
| 250        | 95.9                         | 60.0            | 3.8         | 60.0              | 1.59            | 1.6         | <b>37.5</b> | 0.5          | 38.2              |
| 315        | 95.6                         | 57.6            | 6.4         | 57.6              | 1.50            | 1.3         | <b>39.3</b> | 1.7          |                   |
| 400        | 94.9                         | 52.7            | 9.2         | 52.7              | 1.43            | 1.1         | <b>43.3</b> | 0.7          |                   |
| 500        | 92.6                         | 46.5            | 3.3         | 46.5              | 1.43            | 1.1         | <b>47.2</b> |              | 45.6              |
| 630        | 91.5                         | 44.8            | 1.6         | 44.8              | 1.45            | 1.2         | <b>47.9</b> |              |                   |
| 800        | 92.1                         | 41.4            | 4.0         | 41.4              | 1.55            | 1.5         | <b>52.2</b> |              |                   |
| 1 000      | 91.8                         | 38.2            | 14.9        | 38.2              | 1.56            | 1.5         | <b>55.1</b> |              | 54.5              |
| 1 250      | 92.7                         | 35.7            | 3.8         | 35.7              | 1.49            | 1.3         | <b>58.3</b> |              |                   |
| 1 600      | 95.5                         | 38.6            | 4.1         | 38.6              | 1.50            | 1.3         | <b>58.2</b> |              |                   |
| 2 000      | 97.3                         | 45.5            | 5.1         | 45.5              | 1.49            | 1.3         | <b>53.1</b> |              | 46.6              |
| 2 500      | 96.1                         | 54.5            | 5.7         | 54.5              | 1.30            | 0.7         | <b>42.3</b> | 6.7          |                   |
| 3 150      | 95.3                         | 54.1            | 7.1         | 54.1              | 1.22            | 0.4         | <b>41.6</b> | 7.4          |                   |
| 4 000      | 97.0                         | 50.6            | 10.1        | 50.6              | 1.23            | 0.4         | <b>46.8</b> |              | 44.8              |
| 5 000      | 101.0                        | 50.6            | 10.0        | 50.6              | 1.12            | 0.0         | <b>50.4</b> |              |                   |
| 6 300      |                              |                 |             |                   |                 |             |             |              |                   |
| 8 000      |                              |                 |             |                   |                 |             |             |              |                   |
| 10 000     |                              |                 |             |                   |                 |             |             |              |                   |

|                              |                   |           |            |                                 |             |
|------------------------------|-------------------|-----------|------------|---------------------------------|-------------|
| <b>Single Figure Ratings</b> | <b>Rw</b>         | <b>C</b>  | <b>Ctr</b> | <b>Total U. Dev., dB</b>        | <b>25.2</b> |
| <b>BS EN ISO 717-1: 1997</b> | <b>dB</b>         | <b>dB</b> | <b>dB</b>  |                                 |             |
|                              | <b>45</b>         | <b>-2</b> | <b>-6</b>  |                                 |             |
|                              | <b>(100-5000)</b> | <b>-1</b> | <b>-6</b>  |                                 |             |
|                              | <b>(50-3150)</b>  | <b>-4</b> | <b>-14</b> |                                 |             |
|                              | <b>(50-5000)</b>  | <b>-3</b> | <b>-14</b> |                                 |             |
|                              |                   |           |            | Procedure: ISO140/3/B - issue 2 |             |
|                              |                   |           |            | Worksheet: 140_3_1.XLS          |             |

Customer: **British Gypsum**



## APPENDIX B - TEST METHOD AND CONDITIONS

The source room (T2) was treated with six perspex diffusers of approximately 900mm x 1220mm. An omni-directional loudspeaker sound source is placed near a back corner of the source room (T2), rotating at 1 rpm and at least 0.7m from any room boundary to satisfy Annex C of BS EN ISO 140-3: 1995. A stationary loudspeaker sound source is placed in the corner of the receiving room (T1) opposite the test specimen.

The average sound pressure level in each 1/3 octave band is measured using a rotating microphone boom, positioned such that the minimum distance between microphone and sound source is 1m and between microphone and room boundaries is 0.7m. The rotating microphone has a sweep radius of at least 1m and is inclined in relation to the boundaries at an angle of at least 30° to the horizontal. The microphone has a traverse time of 32 seconds, and the sound pressure levels are averaged over 64 seconds which is equivalent to two complete sweeps of the microphone boom.


The equivalent absorption area of the receiving room is determined by producing the arithmetic average of twelve reverberation times and applying this to the Sabine formula.

The test specimen is installed in the aperture so that it finishes flush with the first independent timber in room T2 side to eliminate indirect transmission between rooms. The specimen is not installed so that the aperture depth ratio 2:1 is met as recommended in section 5.2.1 of BS EN ISO 140-3:1995. Laboratory tests have been carried out to prove the insignificance of this installation position on the test results.

The laboratory limit for measurement due to flanking is (combined BTC 11709A, BTC13562EA, BTC 15398A and BTC 15829A)

| Freq<br>Hz | 50   | 63   | 80   | 100  | 125  | 160  | 200  | 250  | 315  | 400  | 500  | 630   | 800   | 1000 | 1250  | 1600  | 2000  | 2500  | 3150 | 4000 | 5000 |
|------------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|------|-------|-------|-------|-------|------|------|------|
| R'max      | 45.0 | 46.9 | 58.5 | 62.4 | 62.9 | 67.7 | 71.2 | 77.2 | 84.2 | 92.0 | 97.7 | 101.5 | 103.8 | 97.6 | 102.4 | 104.8 | 101.8 | 102.9 | 98.7 | 96.4 | 96.2 |

The figure below shows flanking and isolation treatments in the test chamber.

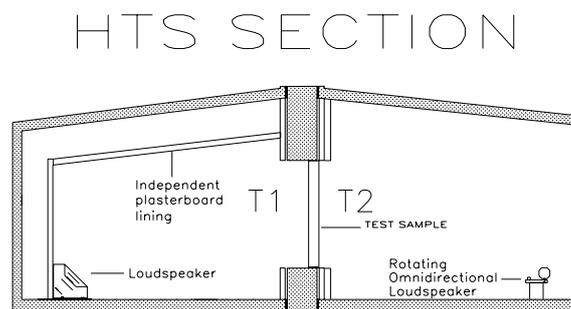

Chamber layout

Customer: **British Gypsum**

BTC 16499A: Page 13 of 13



0296