



# **The Building Test Centre**

**Fire Acoustics Structures**

**The Building Test Centre**  
British Gypsum Limited  
East Leake  
Loughborough  
Leics. LE12 6NP  
Tel (0115) 945 1564  
Fax (0115) 945 1562  
email [btc.testing@bpb.com](mailto:btc.testing@bpb.com)  
web site [www.btconline.co.uk](http://www.btconline.co.uk)

Report Number **BTC 12154A**

SOUND INSULATION TEST TO BS EN ISO 140-3:1995  
ON A BRITISH GYPSUM GYPWALL dB PLUS  
PARTITION SYSTEM INCORPORATING 70mm  
ACOUSTUDS AT 600mm CENTRES, CLAD WITH A  
DOUBLE LAYER OF 12.5mm GYPROC WALLBOARD  
EACH SIDE.

Test Date: 2<sup>nd</sup> August 2002

[www.btconline.co.uk](http://www.btconline.co.uk)

Customer: **British Gypsum Ltd.**  
East Leake  
Loughborough  
Leicestershire  
LE12 6HX

Customer: **British Gypsum Ltd.**

BTC 12154A: Page 1 of 9



0296



SOUND INSULATION TEST TO BS EN ISO 140-3:1995 ON A BRITISH GYPSUM GYPWALL  
dB PLUS PARTITION SYSTEM INCORPORATING 70mm ACOUSTUDS AT 600mm CENTRES,  
CLAD WITH A DOUBLE LAYER OF 12.5mm GYPROC WALLBOARD EACH SIDE.

## TABLE OF CONTENTS

<b>FOREWORD</b>	<b>3</b>
<b>REPORT AUTHORISATION</b>	<b>3</b>
<b>TEST CONSTRUCTION</b>	<b>4</b>
<b>TEST MATERIALS</b>	<b>5</b>
Gyproc Wallboard	5
Metal components	5
Fasteners	5
<b>TEST PROCEDURE</b>	<b>6</b>
<b>TEST RESULTS</b>	<b>6</b>
<b>LIMITATIONS</b>	<b>6</b>
<b>APPENDIX A: TEST DATA</b>	<b>7</b>
<b>APPENDIX B: TEST METHOD AND CONDITIONS</b>	<b>9</b>



## FOREWORD

This test report details a sound insulation test conducted on a sheet and stud partition system. The test sponsor was British Gypsum Ltd.

The test specimen was installed by British Gypsum Limited. The construction of the specimen took place on the 1<sup>st</sup> & 2<sup>nd</sup> August 2002.

## REPORT AUTHORISATION

Report Author

**Franklin Sanicharane**  
HND, BEng. (Hons.), AMIMechE.  
Technologist

Authorised by

**Eur Ing. Paul Howard**  
BSc. (Hons.), CEng., MIOA  
Head of Laboratory

*The Building Test Centre will not discuss the content of this report without written permission from the test sponsor. The Building Test Centre retains ownership of the test report content but authorises the test sponsor to reproduce the report as necessary in its entirety only.*

Customer: **British Gypsum Ltd.**

BTC 12154A: Page 3 of 9




0296

## TEST CONSTRUCTION

Gyproc 72C50 floor and ceiling metal channels were screw fixed at 600mm centres to the head and the base of the test aperture using 25mm Gyproc Drywall screws. Gyproc 70A550 Acoustuds were inserted between the head and base channels at 600mm centres.

A double layer of 12.5mm Gyproc Wallboard was screw fixed to either side of the metal framework. The first layer of boards, was screw fixed at 300mm centres around the perimeter using 25mm Gyproc Drywall screws. The second layer of boards were screw fixed at 300mm centres around the perimeter, and at 300mm centres within the field of the boards using 36mm Gyproc Drywall screws. The perimeter of the partition was sealed to the test aperture with Gyproc sealant. The board joints and screw heads were covered with adhesive tape. All the board joints were left staggered.

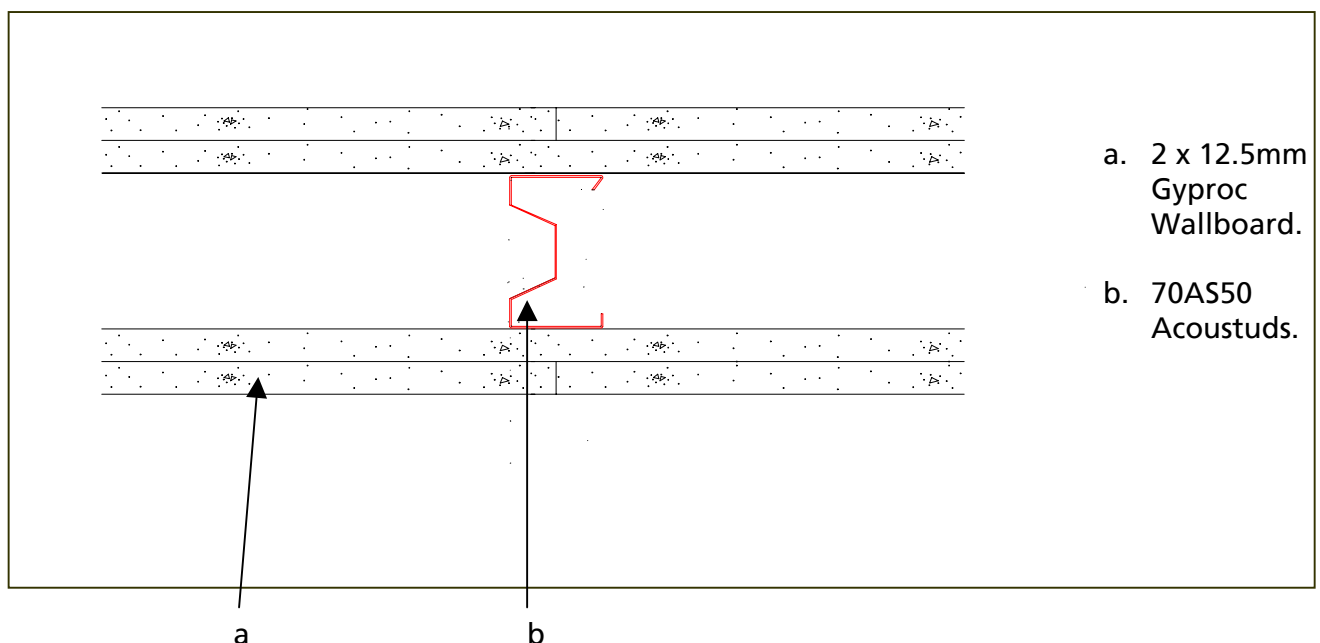

**Figure 1.** Cross-section through the partition.

*The descriptions of individual components making up the test specimen were provided by the customer and were checked for accuracy wherever possible.*



## TEST MATERIALS

### Gyproc SoundBloc

Nominally 2400mm (long) x 1200mm (wide) x 12.5mm (thick) Gyproc board, manufactured by British Gypsum ex East Leake Works.

Average surface density:	7.94 kg/m <sup>2</sup>
Actual thickness:	12.43 mm
Board code:	161552 02:44

The surface density was calculated using the actual weight and size of the boards used in the test specimen.

### Metal components

- i) 72C50 channels manufactured from hot dipped galvanised mild steel.
- ii) 70mm Acoustuds manufactured from hot dipped galvanised mild steel 0.5mm thick, using the Ultrasteel process.

All components supplied by British Gypsum Ltd.

### Fasteners

- i) 25mm Gyproc S point Drywall screws supplied by British Gypsum Limited.
- ii) 36mm Gyproc S point Drywall screws supplied by British Gypsum Limited.

Where measurements could not be taken then weight and dimensions were provided by the customer or the manufacturer e.g. from material labelling. Material information was recorded according to procedure MAT/1.

## TEST PROCEDURE

The test specimen (3.6 m x 2.4 m) was constructed in a wall dividing two reverberant rooms of approximately 98m<sup>3</sup> and 62m<sup>3</sup>. The accuracy of the test method conforms to BS EN 20140-2:1993, the test procedure used was 140/3 issue 4. Broad-band white noise was used to measure the level differences and broad-band pink noise was used to measure the reverberation times. Third octave band pass filters were used in real time mode. See appendix B for further information.

## TEST RESULTS

**Weighted Airborne Sound Reduction Index**

**$R_w$  (C; Ctr) = 47 (-3; -9) dB**

For full data see pages 7 - 8.

Test conducted in accordance with BS EN ISO 140-3: 1995  
Rated in accordance with BS EN ISO 717-1: 1997

## LIMITATIONS

The results only relate to the behaviour of the element of construction under the particular conditions of test; they are not intended to be the sole criteria for assessing the potential acoustic performance of the element in use nor do they reflect the actual behaviour.

The specification and interpretation of test methods are the subject of ongoing development and refinement. Changes in associated legislation may also occur. For these reasons it is recommended that the relevance of test reports over 5 years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test to ensure that they are consistent with current practices, and if required may endorse the test report.

Customer: **British Gypsum Ltd.**

BTC 12154A: Page 6 of 9




0296

## APPENDIX A- TEST DATA

Test Code:
H12154BA
Test Date:
02/08/02

Freq. Hz	R dB
50	16.8
63	13.1
80	10.8
100	20.7
125	23.7
160	33.2
200	36.2
250	38.7
315	38.2
400	43.9
500	49.3
630	47.1
800	50.5
1 000	53.7
1 250	57.6
1 600	58.8
2 000	58.9
2 500	51.7
3 150	46.0
4 000	48.3
5 000	52.0
6 300	
8 000	
10 000	

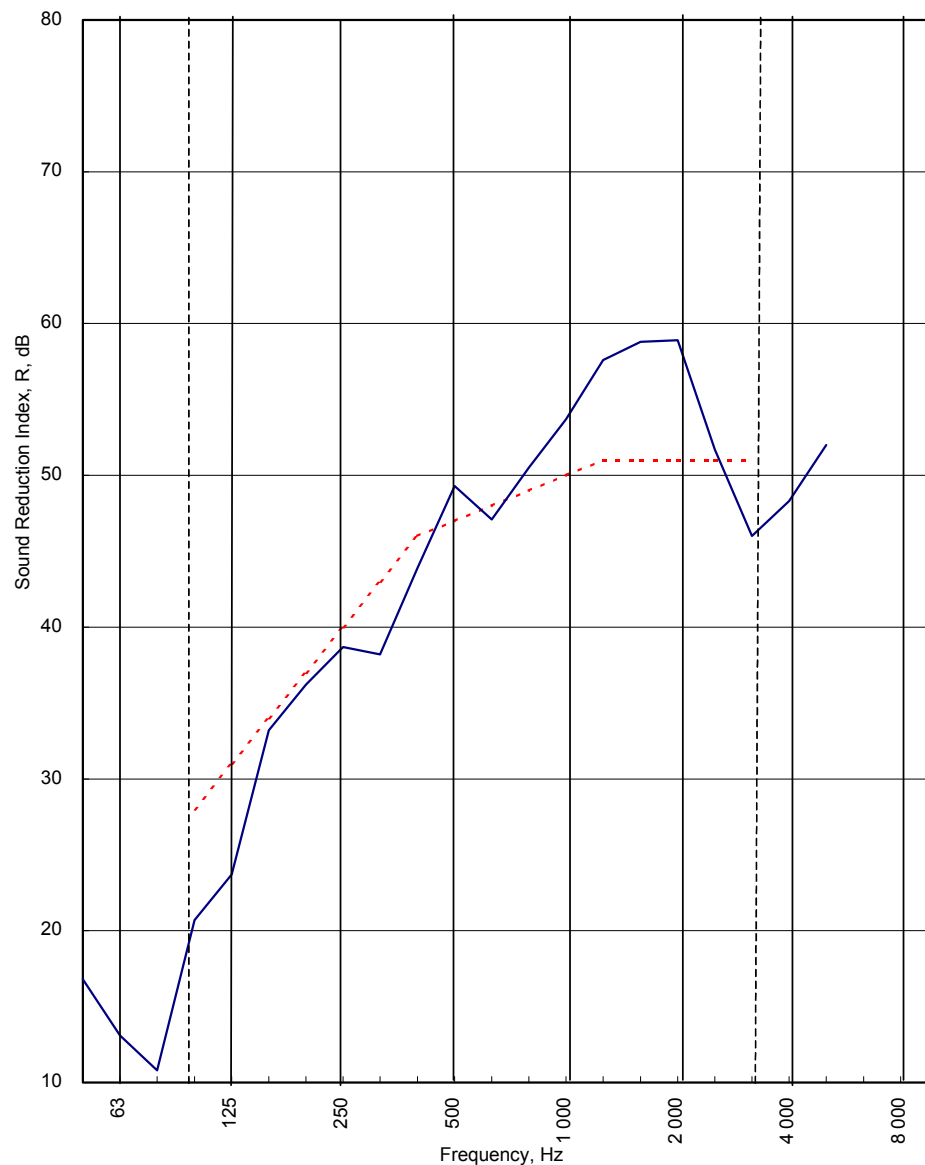

Rating according to  
BS EN ISO 717-1:1997

Evaluation based on laboratory  
measurement results obtained by  
an engineering method:

**R<sub>w</sub> (C;C<sub>tr</sub>) = 47 (-3;-9) dB**

Max dev. 7.3 dB at 125 Hz

C<sub>50-3150</sub> = -7 dB

C<sub>50-5000</sub> = -6 dB

C<sub>100-5000</sub> = -2 dB

C<sub>tr,50-3150</sub> = -18 dB

C<sub>tr,50-5000</sub> = -18 dB

C<sub>tr,100-5000</sub> = -9 dB

Customer: **British Gypsum Ltd.**

BTC 12154A: Page 7 of 9



0296

# LABORATORY AIRBORNE SOUND INSULATION TEST - BS EN ISO 140-3:1995

Test Code: **H12154BA**

Test Date: **02/08/02**

Specimen Area, S = **8.64** m<sup>2</sup>

Room Volume, m<sup>3</sup>:

Room T2

Room T1

Temperature, deg.C:

**98**

**62**

Rel. Humidity, %RH:

**20.2**

**20.3**

**63**

**62**

Freq Hz	Test Room T2 to Test Room T1						R dB	U.Dev. dB	R 1/1Oct dB
	Source dB	Rec. (uc) dB	Bgrnd dB	Rec. (corr) dB	Rev.time Sec	Corr. dB			
50	53.2	35.2	28.3	<b>34.2</b>	<b>0.69</b>	-2.2	<b>16.8</b>		
63	56.7	44.5	13.6	44.5	<b>1.41</b>	0.9	<b>13.1</b>		12.9
80	58.1	46.6	8.5	46.6	0.97	-0.7	<b>10.8</b>		
100	70.3	48.2	24.7	48.2	0.83	-1.4	<b>20.7</b>	7.3	
125	74.3	50.4	15.6	50.4	1.10	-0.2	<b>23.7</b>	7.3	23.5
160	80.9	48.7	26.5	48.7	1.43	1.0	<b>33.2</b>	0.8	
200	86.4	51.4	27.1	51.4	1.53	1.2	<b>36.2</b>	0.8	
250	88.7	51.2	12.6	51.2	1.52	1.2	<b>38.7</b>	1.3	37.6
315	88.6	50.4	20.1	50.4	1.15	0.0	<b>38.2</b>	4.8	
400	86.7	43.1	19.1	43.1	1.24	0.3	<b>43.9</b>	2.1	
500	84.9	36.0	15.8	36.0	1.27	0.4	<b>49.3</b>		46.2
630	83.6	36.9	16.1	36.9	1.27	0.4	<b>47.1</b>	0.9	
800	84.0	34.0	15.4	34.0	1.28	0.5	<b>50.5</b>		
1 000	84.0	31.7	15.1	31.7	1.60	1.4	<b>53.7</b>		53.0
1 250	84.6	29.0	14.8	<b>28.8</b>	1.72	1.8	<b>57.6</b>		
1 600	87.6	30.3	14.2	30.3	1.63	1.5	<b>58.8</b>		
2 000	89.1	32.1	13.9	32.1	1.76	1.9	<b>58.9</b>		55.1
2 500	88.0	37.9	11.3	37.9	1.67	1.6	<b>51.7</b>		
3 150	87.3	42.3	10.7	42.3	1.46	1.0	<b>46.0</b>	5.0	
4 000	87.0	39.8	11.0	39.8	1.47	1.1	<b>48.3</b>		48.1
5 000	84.3	33.5	19.8	<b>33.3</b>	1.45	1.0	<b>52.0</b>		
6 300									
8 000									
10 000									

Single Figure Ratings	<b>Rw</b>	<b>C</b>	<b>Ctr</b>	Total U. Dev., dB	<b>30.3</b>
BS EN ISO 717-1: 1997	<b>dB</b>	<b>dB</b>	<b>dB</b>		
	<b>47</b>	<b>-3</b>	<b>-9</b>		
	(100-5000)	<b>-2</b>	<b>-9</b>		
Background Corrected					
	(50-3150)	<b>-7</b>	<b>-18</b>		
RT's > factor 1.5 apart					
Tested Serially[ ] Real Time[ ]	(50-5000)	<b>-6</b>	<b>-18</b>		

Customer: **British Gypsum Ltd.**

BTC 12154A: Page 8 of 9



0296



## APPENDIX B- TEST METHOD AND CONDITIONS

The source room (T2) was treated with six perspex diffusers of approximately 900mm x 1220mm. An omni-directional loudspeaker sound source is placed near a back corner of the source room (T2), rotating at 1 rpm and at least 0.7m from any room boundary to satisfy Annex C of BS EN ISO 140-3: 1995. A stationary loudspeaker sound source is placed in the corner of the receiving room (T1) opposite the test specimen.

The average sound pressure level in each 1/3 octave band is measured using a rotating microphone boom, positioned such that the minimum distance between microphone and sound source is 1m and between microphone and room boundaries is 0.7m. The rotating microphone has a sweep radius of at least 1m and is inclined in relation to the boundaries at an angle of at least 30° to the horizontal. The microphone has a traverse time of 32 seconds, and the sound pressure levels are averaged over 64 seconds which is equivalent to two complete sweeps of the microphone boom.

The equivalent absorption area of the receiving room is determined by producing the arithmetic average of six reverberation times and applying this to the Sabine formula.

The test specimen is installed in the aperture so that it finishes flush with the first independent timber in room T2 side to eliminate indirect transmission between rooms. The specimen is not installed so that the aperture depth ratio 2:1 is met as recommended in section 5.2.1 of BS EN ISO 140-3:1995. Laboratory tests have been carried out to prove the insignificance of this installation position on the test results.

The laboratory limit for measurement due to flanking is (BTC 11709A)

Freq Hz	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000
R'max	45.0	46.9	56.3	61.8	58.5	60.6	62.5	66.3	74.1	79.5	85.0	90.4	93.8	95.0	95.3	98.3	100.4	98.5	96.3	93.9	91.1

The figure below show flanking and isolation treatments in the test chamber.

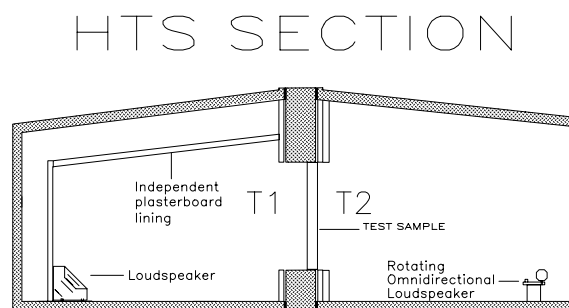


Figure 2 Chamber layout.

Customer: **British Gypsum Ltd.**