


Technical Specification

This document provides guidance on how to achieve performance and warranty requirements by exclusively using British Gypsum products or system specifications.

GypLyner Independent

B216004 (E) MR1 (EN)

Inner layer of Gyproc WallBoard 15mm with an outer layer of Gyproc Moisture Resistant 15mm to one side of Gypframe 92 I 90 'I' Stud framework with 50mm Isover Steel Frame Infill Batts between studs forming an independent lining to structural steel columns, in association with external steel cladding (0.6mm). For heights up to 4000mm.

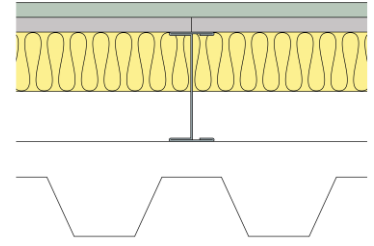

Background

| | |
|------------|--------------------------|
| Background | Steel Clad External Wall |
|------------|--------------------------|

Head design

| | |
|--------------|--|
| Head channel | Gypframe 94 FEC 50 Folded Edge Standard Floor & Ceiling Channel |
|--------------|--|

Gypframe channel suitably fixed to soffit at 600mm centres in two lines staggered by 300mm.

| | |
|----------------------|--|
| Deflection allowance | Vertical deflection only. To be determined by a Structural Engineer. |
|----------------------|--|

Framework

| | |
|------|----------------------------------|
| Stud | Gypframe 92 I 90 'I' Stud |
|------|----------------------------------|

| | |
|-------------------------|-----|
| Stud centres - Max (mm) | 600 |
|-------------------------|-----|

| | |
|------------------------|----------------------------------|
| Abutments and openings | Gypframe 92 S 50 'C' Stud |
|------------------------|----------------------------------|

Gypframe 'C' stud suitably fixed to structure at 600mm centres in two lines staggered by 300mm.

| | |
|--------------|--|
| Base channel | Gypframe 94 FEC 50 Folded Edge Standard Floor & Ceiling Channel |
|--------------|--|

Gypframe channel suitably fixed to floor at 600mm centres in two lines staggered by 300mm.

Insulation

| | |
|---------------------|--|
| Insulation, Layer 1 | 50mm Isover Steel Frame Infill Batt |
|---------------------|--|

Board and fixings

| | | | |
|-----------------------|------------------------------|------------------------|--|
| Board side 1, Layer 1 | Gyproc WallBoard 15mm | Screws side 1, Layer 1 | British Gypsum Jack-Point Screws 25mm |
|-----------------------|------------------------------|------------------------|--|

| | | | |
|-----------------------|---------------------------------------|------------------------|--|
| Board side 1, Layer 2 | Gyproc Moisture Resistant 15mm | Screws side 1, Layer 2 | British Gypsum Jack-Point Screws 41mm |
|-----------------------|---------------------------------------|------------------------|--|

Board layer 1 (inner), fix securely to Gypframe metal supports around the perimeter of the board at maximum 300mm centres; Board layer 2 (outer), fix securely to all Gypframe metal supports around the perimeter of the board and intermediate stud positions at maximum 300mm centres. External corners reduce fixings to 200mm. Drywall screws can be used for fixing boards to metal profiles with a thickness of 0.8mm or less (excluding 'I' studs). All joints staggered between layers. Fix working from the centre of each board. Position screws not less than 13mm from cut edges and 10mm from bound edges of boards. Set screw heads flush with plasterboard surface; do not break paper or gypsum core.

| | |
|--------------|-----------------------------------|
| Fixing strap | Gypframe GFS1 Fixing Strap |
|--------------|-----------------------------------|

Used to support horizontal board joints in face layer of multiple layer board linings and enable board screw fixing at 300mm centres.

| | |
|---------|-----------------------|
| Sealant | Gyproc Sealant |
|---------|-----------------------|

Locate sealant at junctions with adjoining structure and other air paths. Apply as a continuous bead to clean, dry, dust-free surfaces, leaving no gaps. After application of sealant, bulk fill gaps between floor and underside of plasterboard using Gyproc jointing compound.

Finish coat

To achieve the specified performances, the system should be finished using either one of our Thistle or ThistlePro plasters, or Gyproc jointing products. See the product range guides on the British Gypsum website for more information. For further guidance on skimming moisture resistant grade boards see the White Book - Finishes section.


Technical Specification

This document provides guidance on how to achieve performance and warranty requirements by exclusively using British Gypsum products or system specifications.

GypLyner Independent

B216004 (E) MR1 (EN)

Inner layer of Gyproc WallBoard 15mm with an outer layer of Gyproc Moisture Resistant 15mm to one side of Gyproframe 92 I 90 'I' Stud framework with 50mm Isover Steel Frame Infill Batts between studs forming an independent lining to structural steel columns, in association with external steel cladding (0.6mm). For heights up to 4000mm.

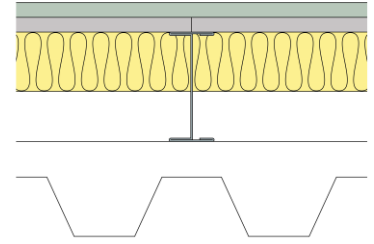

System performance

Please read performance data with any associated standards.

| | |
|-----------------------|-------------|
| Fire integrity (mins) | 30 |
| Maximum height (mm) | 4000 |

| | |
|------------------------|-----------|
| Fire insulation (mins) | 30 |
|------------------------|-----------|

The maximum heights quoted are limited by the fire state field of application or by limiting deflection of L/240 at 200 Pa, whichever is the lower of the two.

| | |
|------------------------------|---------------|
| Duty rating | Severe |
| Minimum cavity / offset (mm) | 30 |

The minimum cavity/offset is recommended to avoid bridging between the background and metal studs over the lining system height.

| | |
|-------------------------------------|-----------|
| Approx. weight (kg/m ²) | 22 |
|-------------------------------------|-----------|

Standards

These standards relate to the above performance data.

BS 5234-2, Specification for performance requirements for strength and robustness including methods of test.

BS EN 1364-1, Fire resistance tests for non-loadbearing elements - Walls.

Test reports

These test reports relate to the above performance data.

Fire Resistance Test Report BTC 21131F

Partition Duty Test Report BTC 317LC

Further information

SpecSure® system performance warranty confirms that British Gypsum proprietary systems will perform as specified for the lifetime of the building. The **SpecSure®** warranty requires that all components are specified in full and constructed in accordance with British Gypsum's installation guidance. For more details see the British Gypsum website. Always check with the design team before making any changes to the chosen specification, ensuring appropriate substantiation is sought to confirm that the solution still meets all required project performances.