



The Building Test Centre

Fire Acoustics Structures

The Building Test Centre
British Gypsum Limited
East Leake
Loughborough
Leics. LE12 6NP
Tel (0115) 945 1564
Fax (0115) 945 1562
email btc.testing@bpb.com

Report Number **BTC 11332A**

AN ACOUSTIC TEST REPORT COVERING A
LABORATORY SOUND INSULATION TEST TO
BS EN ISO 140-3: 1995 ON A 92S55 METAL STUD
PARTITION INCORPORATING GYPROC RESILIENT BAR
ON ONE SIDE, A DOUBLE LAYER OF 12.5mm GYPROC
SOUNdBLOC ON BOTH SIDES AND 50mm ISOWOOL
1200 IN THE CAVITY

Test Date: 19th December 2000

Customer: British Gypsum Limited
East Leake
Loughborough
Leicestershire
LE12 6HX

Customer: **British Gypsum Limited**

BTC 11332A: Page 1 of 9



No. 0296

AN ACOUSTIC TEST REPORT COVERING A LABORATORY SOUND INSULATION TEST TO BS EN ISO 140-3: 1995 ON A 92S55 METAL STUD PARTITION INCORPORATING GYPROC RESILIENT BAR ON ONE SIDE, A DOUBLE LAYER OF 12.5mm GYPROC SOUNDnBLOC ON BOTH SIDES AND 50mm ISOWOOL 1200 IN THE CAVITY.

TABLE OF CONTENTS

FOREWORD	3
REPORT AUTHORISATION	3
TEST CONSTRUCTION	4
TEST MATERIALS	5
Gyproc SoundBloc	5
Metal components	5
Fasteners	5
Insulation	5
TEST PROCEDURE	6
TEST RESULTS	6
LIMITATIONS	6
APPENDIX A – TEST DATA	7
APPENDIX B – LABORATORY DETAILS	9

FOREWORD

This test report details a sound insulation test conducted on a sheet and stud partition system. The test sponsor was British Gypsum Limited.

The test specimen was installed by British Gypsum Limited. The construction of the specimen took place on the 15th, 18th and 19th December 2000. The Building Test Centre played no role in the design or selection of the materials comprising the test specimen.

REPORT AUTHORISATION

Report Author

Sarah Wood
B.Eng. (Hons.), AMIOA
Project Leader

Authorised by

Eur Ing. **Paul Howard**
BSc. (Hons.), CEng., MIOA
Head of Laboratory

The Building Test Centre will not discuss the content of this report without written permission from the test sponsor. The Building Test Centre retains ownership of the test report content but authorises the test sponsor to reproduce the report as necessary in its entirety only.

TEST CONSTRUCTION

Gyproc 94C55 channel was fixed to the head and base of the test aperture using 36mm Gyproc Drywall screws at 600mm centres. Gyproc 92S55 studs were set at 600mm centres between the head and base channel. 50mm Isowool 1200 was placed between the studs.

Gyproc Resilient Bar was fixed horizontally and upside down at 600mm centres to one side of the framework using 25mm Gyproc Wafer Head screws. Gyproc Resilient Bar noggings were fixed vertically to the end studs.

The metal framework was clad both sides with a double layer of 12.5mm Gyproc SoundBloc board. The inner layer boards were fixed with 25mm Gyproc Drywall screws at 230mm centres to the resilient bar and around the perimeter of the boards. The outer layer boards were fixed with 42mm Gyproc Drywall screws at 230mm centres to the resilient bar and around the perimeter of the boards. Boards on the non resilient bar side were fixed at 300mm centres. All joints were staggered from side to side and between layers.

Screwheads and joints were taped with Gyproc self adhesive tape. The perimeter of the partition was sealed with Gyproc Sealant.

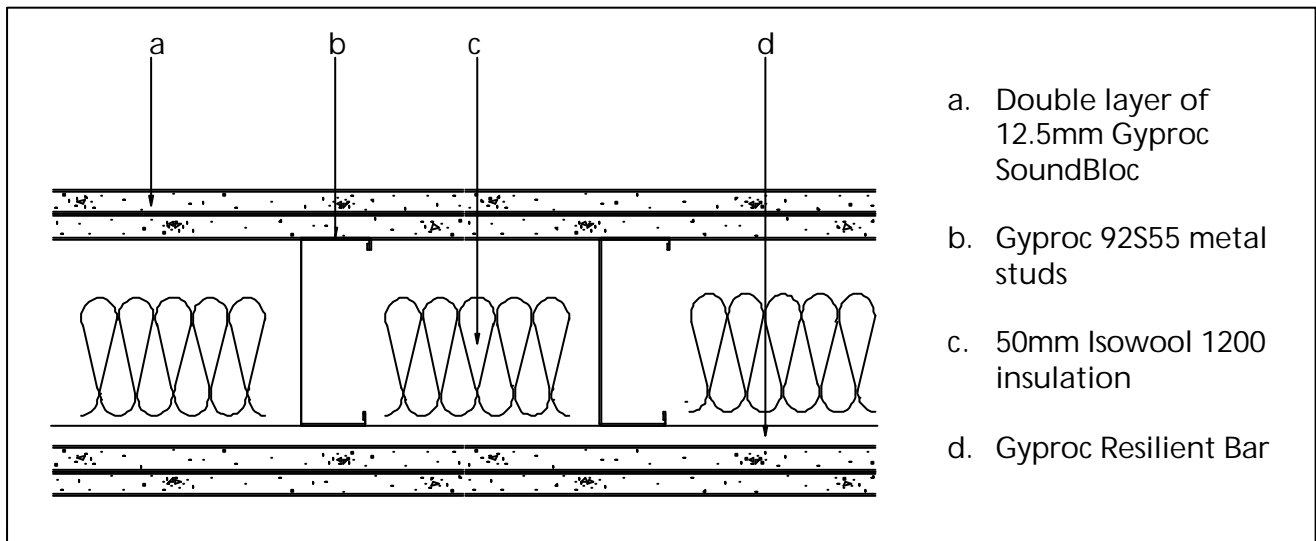


Figure 1. Cross-section through the partition

The descriptions of individual components making up the test specimen were provided by the customer and were checked for accuracy wherever possible.

TEST MATERIALS

Gyproc SoundBloc

Nominally 2400mm (long) x 1200mm (wide) x 12.5mm (thick) Gyproc SoundBloc manufactured by British Gypsum Limited, ex Kirby Thore works.

Average surface density:	10.66 kg/m ²
Average thickness:	12.44 mm
Board identification number:	27-290-0 23:05

The surface density and thickness was calculated using the actual weight, size and thickness of the boards used in the test specimen.

Metal components

- i) Gyproc 92S55 metal studs, nominally 0.55mm thick, manufactured from galvanised mild steel using the 'Ultrasteel' process.
- ii) Gyproc 94C55 channel, nominally 0.55mm thick, manufactured from galvanised mild steel using the 'Ultrasteel' process.
- iii) Gyproc Resilient Bar manufactured from galvanised mild steel.

All metal components supplied by British Gypsum Limited.

Fasteners

- i) 25mm Gyproc Drywall screws.
- ii) 36mm Gyproc Drywall screws.
- iii) 42mm Gyproc Drywall screws.
- iv) 25mm Gyproc Wafer Head screws.

All fasteners supplied by British Gypsum Limited.

Insulation

Isowool 1200 acoustic partition roll, nominally 50mm thick. Manufactured and supplied by British Gypsum-Isover Limited.

Approximate surface density:	0.63 kg/m ²
Approximate density:	12.60 kg/m ³

Customer: **British Gypsum Limited**

Surface density calculated using the weight of one roll of 50mm Isowool 1200 insulation and its surface area and nominal thickness.

Where measurements could not be taken then weight and dimensions were provided by the customer or the manufacturer e.g. from material labelling. Material information was recorded according to procedure MAT/1

TEST PROCEDURE

The test specimen (3.6 m x 2.4 m) was constructed in a wall dividing two reverberant rooms of approximately 98m³ and 62m³. The accuracy of the test method conforms to BS EN 20140-2:1993, the test procedure used was 140/3 issue 3. Broad-band white noise was used to measure the level differences and broad-band pink noise was used to measure the reverberation times. Third octave band pass filters were used in real time mode. See appendix for further information.

TEST RESULTS

Weighted Airborne Sound Reduction Index

R_w (C; Ctr) = 61 (-2; -8) dB

For full data see pages 7 - 8.

Test conducted in accordance with BS EN ISO 140-3: 1995
Rated in accordance with BS EN ISO 717/1: 1997

LIMITATIONS

The results only relate to the behaviour of the element of construction under the particular conditions of test; they are not intended to be the sole criteria for assessing the potential acoustic performance of the element in use.

The specification and interpretation of test methods are the subject of ongoing development and refinement. Changes in associated legislation may also occur. For these reasons it is recommended that the relevance of test reports over 5 years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test to ensure that they are consistent with current practices, and if required may endorse the test report.

Customer: **British Gypsum Limited**

BTC 11332A: Page 6 of 9




No. 0296

APPENDIX A – TEST DATA

Test Code: H11332A
Test Date: 19/12/00

Freq. Hz	R dB
50	20.1
63	18.7
80	20.7
100	35.1
125	41.3
160	43.9
200	50.2
250	52.9
315	54.6
400	57.4
500	58.4
630	60.4
800	63.6
1 000	65.6
1 250	67.4
1 600	70.4
2 000	71.2
2 500	70.9
3 150	65.5
4 000	62.5
5 000	64.6
6 300	
8 000	
10 000	

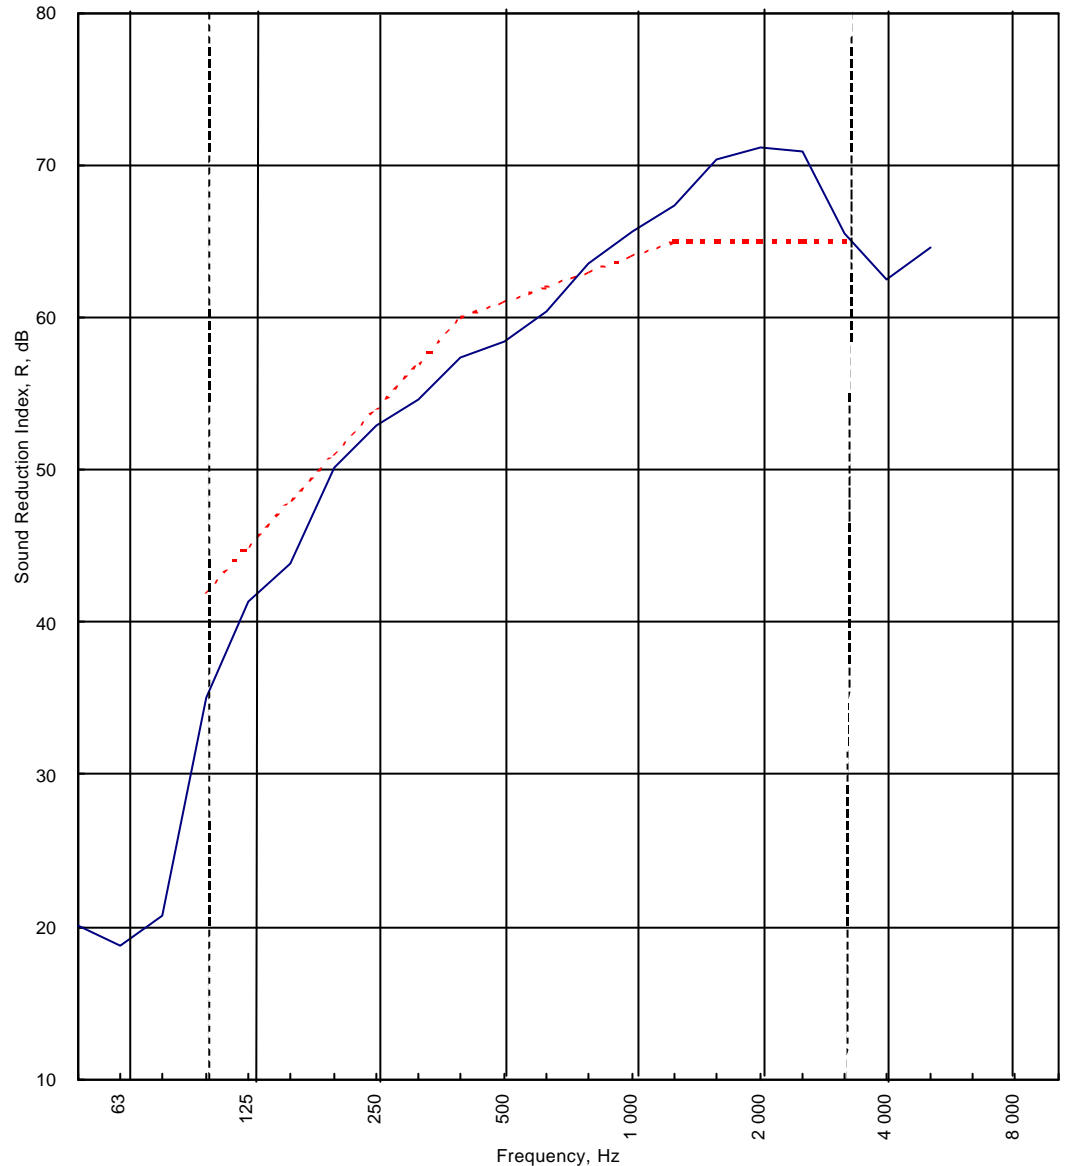

----- Curve of reference values (ISO 717-1)

Rating according to BS EN ISO 717-1:1997	R_w (C;C_{tr}) = 61 (-2;-8) dB		
Evaluation based on laboratory measurement results obtained by an engineering method:	Max dev. 6.9 dB at 100 Hz		
	C ₅₀₋₃₁₅₀ = -11 dB	C ₅₀₋₅₀₀₀ = -10 dB	C ₁₀₀₋₅₀₀₀ = -2 dB
	C _{tr,50-3150} = -23 dB	C _{tr,50-5000} = -23 dB	C _{tr,100-5000} = -8 dB

Customer: **British Gypsum Limited**

BTC 11332A: Page 7 of 9



No. 0296

LABORATORY AIRBORNE SOUND INSULATION TEST - BS EN ISO 140-3:1995

Test Code: **H11332A**

Test Date: **19/12/00**

Specimen Area, S = **8.64** m²

	Room T2	Room T1
Room Volume, m ³ :	98	62
Temperature, deg.C:	11.1	10.8
Rel. Humidity, %RH:	62.9	65

Freq Hz	Test Room T2 to Test Room T1						R dB	U.Dev. dB	R 1/1Oct dB
	Source dB	Rec. (uc) dB	Bgrnd dB	Rec. (corr) dB	Rev.time Sec	Corr. dB			
50	58.1	34.3	19.3	34.2	0.48	-3.8	20.1		
63	61.6	41.4	19.8	41.4	0.82	-1.5	18.7		19.8
80	64.8	42.3	9.2	42.3	0.76	-1.8	20.7		
100	73.8	38.1	26.2	37.8	0.93	-0.9	35.1	6.9	
125	79.5	38.1	11.0	38.1	1.13	-0.1	41.3	3.7	38.5
160	86.6	43.1	10.4	43.1	1.27	0.4	43.9	4.1	
200	92.1	42.8	26.8	42.8	1.42	0.9	50.2	0.8	
250	95.0	43.8	17.0	43.8	1.70	1.7	52.9	1.1	52.2
315	95.6	41.4	14.4	41.4	1.25	0.4	54.6	2.4	
400	93.9	37.4	14.3	37.4	1.40	0.9	57.4	2.6	
500	91.6	33.9	11.5	33.9	1.35	0.7	58.4	2.6	58.6
630	90.6	30.7	8.2	30.7	1.30	0.5	60.4	1.6	
800	90.5	28.2	10.2	28.2	1.55	1.3	63.6		
1 000	90.2	26.3	11.7	26.1	1.62	1.5	65.6		65.3
1 250	91.7	26.3	8.2	26.3	1.81	2.0	67.4		
1 600	94.1	25.9	7.8	25.9	1.89	2.2	70.4		
2 000	95.6	26.3	6.8	26.3	1.77	1.9	71.2		70.8
2 500	93.9	24.4	6.6	24.4	1.60	1.4	70.9		
3 150	92.8	28.3	7.9	28.3	1.44	1.0	65.5		
4 000	91.8	30.1	9.9	30.1	1.38	0.8	62.5		64.0
5 000	90.4	26.5	11.9	26.3	1.28	0.5	64.6		
6 300									
8 000									
10 000									

Single Figure Ratings	Rw	C	Ctr	Total U. Dev., dB	25.8
BS EN ISO 717-1: 1997	61	-2	-8		
	(100-5000)	-2	-8		
Background Corrected					
	(50-3150)	-11	-23		
RT's > factor 1.5 apart					
Tested Serially[] Real Time[]	(50-5000)	-10	-23		
				Test Procedure: 140/3/issue 3	
				Worksheet: M\OFFICE\EXCEL\140\140_3_1.XLS	



APPENDIX B – LABORATORY DETAILS

The source room (T2) was treated with six perspex diffusers of approximately 900mm x 1220mm. An omni-directional loudspeaker sound source is placed near a back corner of the source room (T2), rotating at 1 rpm and at least 0.7m from any room boundary to satisfy Annex C of BS EN ISO 140-3: 1995. A stationary loudspeaker sound source is placed in the corner of the receiving room (T1) opposite the test specimen.

The average sound pressure level in each 1/3 octave band is measured using a rotating microphone boom, positioned such that the minimum distance between microphone and sound source is 1m and between microphone and room boundaries is 0.7m. The rotating microphone has a sweep radius of at least 1m and is inclined in relation to the boundaries at an angle of at least 30° to the horizontal. The microphone has a traverse time of 32 seconds, and the sound pressure levels are averaged over 64 seconds which is equivalent to two complete sweeps of the microphone boom.

The equivalent absorption area of the receiving room is determined by producing the arithmetic average of six reverberation times and applying this to the Sabine formula.

The test specimen is installed in the aperture so that it finishes flush with the last timber in room T2 side to eliminate indirect transmission between rooms. The specimen is not installed so that the aperture depth ratio 2:1 is met as recommended in section 5.2.1 of BS EN ISO 140-3:1995. Laboratory tests have shown to prove the insignificance of this installation position on the test results.

The laboratory limit for measurement due to flanking is (BTC H 3306A)

Freq. Hz	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000
R'max	32	44	39	55	56	59	64	63	70	77	84	88	91	92	94	97	96	98	96	90	87

The figure below show flanking and isolation treatments in the test chamber.

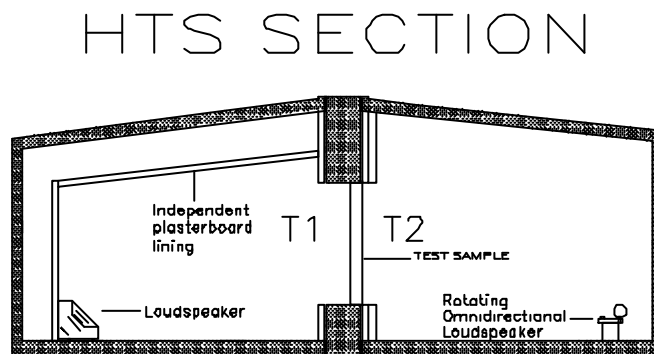


Figure 1. Chamber layout